


 **YORK[®]**

MAXE[™]

**Model YST
Steam-Turbine Drive Centrifugal
Liquid Chillers
Design Level F**

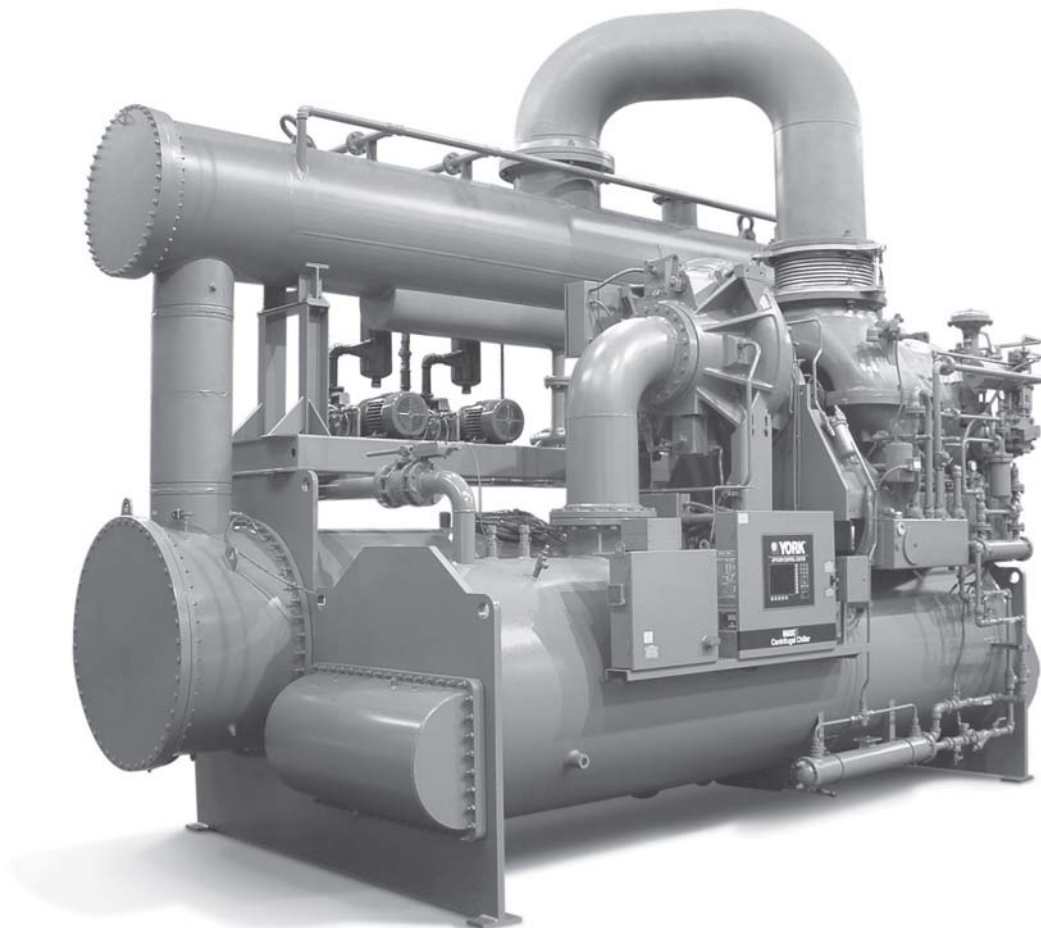

**700 Through 2165 TR
(2500 Through 7400 kW)
Utilizing HFC-134a**




Metric Conversions

TABLE OF CONTENTS

Introduction	3
Ratings	5
OptiView Control Center	6
Equipment Specifications	7
Accessories and Modifications	12
Application Data	14
Dimensions (Ft. - In.) – H Compressor Units	19
Dimensions (Ft. - In.) – Nozzle Arrangements:	
Evaporators – Compact Water Boxes – H Compressor Units	20
Evaporators – Marine Water Boxes – H Compressor Units	21
Refrigerant condensers – Marine Water Boxes – H Compressor Units	22
Dimensions (Ft. - In.) – J Compressor Units	24
Dimensions (Ft. - In.) – Nozzle Arrangements:	
Evaporators – Compact Water Boxes – J Compressor Units	26
Evaporators – Marine Water Boxes – J Compressor Units	27
Refrigerant condensers – Marine Water Boxes – J Compressor Units	28
Steam Condenser	30
Approximate Unit Weights (Lbs.)	31
Marine Water Box Weight Additions (Lbs.)	32
Dimensions (mm) H Compressor Units	33
Dimensions (mm) Nozzle Arrangements:	
Evaporators – Compact Water Boxes – H Compressor Units	34
Evaporators – Marine Water Boxes – H Compressor Units	35
Refrigerant condensers – Marine Water Boxes – H Compressor Units	36
Dimensions (mm) J Compressor Units	38
Dimensions (mm) Nozzle Arrangements:	
Evaporators – Compact Water Boxes – J Compressor Units	40
Evaporators – Marine Water Boxes – J Compressor Units	41
Refrigerant condensers – Marine Water Boxes – J Compressor Units	42
Approximate Unit Weights (Kg)	45
Marine Water Box Weight Additions (Kg)	46
Guide Specifications	47
SI Metric Conversions	52

NOMENCLATURE

The model number denotes the following characteristics of the unit:

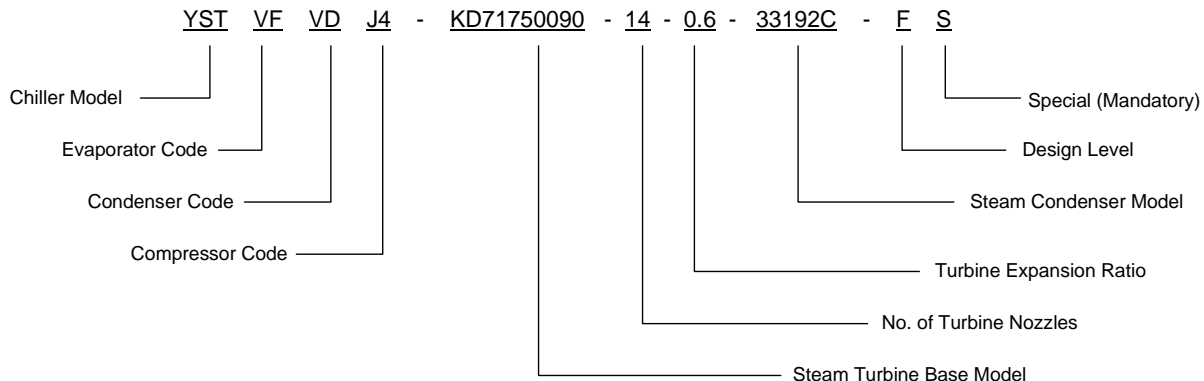

Introduction

The YORK YST MaxE™ Chillers offer a complete combination of features for total owner satisfaction.

MATCHED COMPONENTS MAXIMIZE EFFICIENCY

Overall chiller efficiency cannot be determined by analyzing the theoretical efficiency of any one chiller component. It requires a specific combination of heat exchanger, compressor, steam turbine and steam condenser performance to achieve the lowest system steam rate. YORK YST MaxE chiller technology matches chiller system components to provide maximum chiller efficiency under actual - not just theoretical - operating conditions.

REAL-WORLD ENERGY PERFORMANCE

YORK pioneered the term “Real-World Energy” to illustrate the energy-saving potential of focusing on chiller performance during off-design conditions. Off-design is not only part load, but full load operation as well, with reduced entering refrigerant condenser water temperatures (ECWTs). This is where chillers operate 99% of the time, and where operating costs add up.

The YST MaxE chillers are the only chillers designed to operate on a continuous basis with cold ECWT and full refrigerant condenser flow at all load points, taking full advantage of Real-World conditions. This type of operation benefits the cooling tower as well; reducing cycling of the fan motor and ensuring good coverage of the cooling fill.

YORK YST MaxE chillers offer the most efficient Real-World operation of any chiller, meaning lower operating costs and an excellent return on your chiller investment.

OPEN DRIVE DESIGN

YORK YST MaxE centrifugal chillers utilize an open drive compressor that enables the use of various drives. Specifically, the YST uses a Steam Turbine to provide the rotational power to drive the chiller. The use of steam as the motive energy provides owners the ability to take advantage of the most effective energy source available either by using steam only or by complementing this with other “hybrid” energy sources such as electric or gas.

HIGH-EFFICIENCY HEAT EXCHANGERS

YST MaxE chiller heat exchangers offer the latest technology in heat transfer surface design to give

maximum efficiency and compact design. Water, refrigerant and steam side design enhancements minimize both energy consumption and tube fouling.

SINGLE-STAGE COMPRESSOR DESIGN AND EFFICIENCY PROVEN IN THE MOST DEMANDING APPLICATIONS

Designed to be the most reliable chillers we’ve ever made, YORK YST MaxE centrifugal chillers incorporate single-stage compressor design. With fewer moving parts and straightforward, efficient engineering, YORK single-stage compressors have proven durability records in hospitals, chemical plants, gas processing plants, the U.S. Navy, and in other applications where minimal downtime is a crucial concern.

In thousands of installations worldwide, YORK single-stage compressors are working to reduce energy costs. High strength aluminum-alloy compressor impellers feature backward-curved vanes for high efficiency. Airfoil shaped pre-rotation vanes minimize flow disruption for the most efficient part load performance. Precisely positioned and tightly fitted, they allow the compressor to unload smoothly from 100% to minimum load for excellent operation in air conditioning applications.

MURRAY STEAM TURBINES - PROVEN EXPERIENCE AND HIGH EFFICIENCY

The YORK compressor, driven by a Murray Turbomachinery multistage steam turbine provides the best combination of optimized efficiency and proven track record. Murray multistage turbines are used together with innovative, automated controls to integrate the turbine and compressor seamlessly. The ability of the steam turbine to vary rotational speed provides optimal compressor efficiency at all operating conditions and builds on YORK’s reputation for the best in “Real-World Energy”. Optional automated start and shutdown controls eliminate the traditional manual intervention associated with steam turbine systems.

FLEXIBILITY OF AN ITT STEAM CONDENSER PACKAGE

Unique to the YST chiller is the packaging of a steam condenser suitable for mounting on the chiller or alongside depending on site requirements. By designing the steam condenser for mounting on the chiller the YST footprint is no larger than that of traditional chillers

Introduction (continued)

saving space and simplifying plant layout when the YST chiller is used in combination with other YORK chillers. The same steam condenser package may be installed off the chiller, if required, without modification or eliminated altogether where a steam condensation system already exists on site.

PRECISION CONTROL OF COMPRESSOR OIL PRESSURE

Utilizing our expertise in variable speed drive technology and applications, YORK has moved beyond the fixed head and bypass approach of oil pressure control. The old approach only assures oil pressure at the outlet of the pump rather than at the compressor, and allows no adjustment during chiller operation. The YST MAXE chillers feature a variable speed drive oil pump, monitoring and providing the right amount of oil flow to the compressor on a continuous basis. This design also provides sophisticated electronic monitoring and protection of the oil pump electrical supply, ensuring long life and reliable operation of the oil pump motor. Variable speed drive technology reduces oil pump power consumption, running only at the speed required, rather than at full head with a pressure regulating bypass valve.

FACTORY PACKAGING REDUCES FIELD LABOR COSTS

YORK YST MAXE centrifugal chillers are designed to keep installation costs low. Where installation access is not a problem, the chiller can be shipped completely packaged with steam turbine driveline factory installed. The steam condenser is a modular design, packaged to facilitate site installation on top of the refrigerant condenser or floor mounted adjacent to the chiller, either arrangement requiring minimal piping to complete the installation. The entire system requires a single point power connection to minimize on site wiring.

TAKE ADVANTAGE OF COLDER COOLING TOWER WATER TEMPERATURES

YORK YST MAXE centrifugal chillers have been designed to take full advantage of colder cooling tower water temperatures, which are naturally available during most operating hours. Considerable energy savings are available by letting tower water temperature drop, rather than artificially holding it above 75°F (24°C), especially at low load, as some chillers require.

Ratings

COMPUTERIZED PERFORMANCE RATINGS

Each chiller is custom-matched to meet the individual building load and energy requirements. A large number of standard heat exchangers and pass arrangements are available to provide the best possible match.

It is not practical to provide tabulated performance for each combination, as the energy requirements at both full and part load vary significantly with each heat exchanger and pass arrangement. Computerized ratings are available through each YORK sales office. These ratings can be tailored to specific job requirements.

OFF-DESIGN PERFORMANCE

Since the vast majority of its operating hours are spent at off-design conditions, a chiller should be chosen not

only to meet the full load design, but also for its ability to perform efficiently at lower loads and lower tower water temperatures. It is not uncommon for chillers with the same full load to have an operating cost difference of over 10% due to part-load operation.

Part load information can be easily and accurately generated by use of the computer. And because it is so important to an owner's operating budget, this information has now been standardized in the form of an Integrated Part Load Value (IPLV), and Non-Standard Part Load Value (NPLV). The IPLV / NPLV formulas, in accordance with ARI Standard 550/590 guidelines, much more closely track actual chiller operations. A more detailed analysis must take into account actual building load profiles, and local weather data. Part load performance data should be obtained for each job using its own design criteria.

Optiview Control Center

YST OPTIVIEW CONTROL CENTER

The YORK OptiView Control Center, furnished as standard on each chiller, provides the ultimate in efficiency, automation, monitoring, data recording, chiller protection and operating ease. The Control Center is a factory-mounted, wired and tested state-of-the-art microprocessor based control system for R134a centrifugal chillers. The panel is configured with a 10.4" diagonal color Liquid Crystal Display (LCD) surrounded by "soft" keys, which are redefined with one keystroke based on the screen displayed at that time. This revolutionary development makes chiller operation quicker and easier than ever before. Instead of requiring keystroke after keystroke to hunt for information on a small monochrome LCD screen, a single button reveals a wide array of information on a large, full-color illustration of the appropriate component, which makes information easier to interpret.

The LCD display allows graphic animated display of the chiller, chiller sub-systems and system parameters; this allows the presentation of several operating parameters at once. The novel use of on screen animation enables operators to more readily identify component status. In addition, the operator may view a graphical representation of the historical operation of the chiller as well as the present operation. A Status Bar is displayed at all times on all screens. It contains the System - Status Line and Details Line, the Control Source, Access Level, Time and Date.

During turbine slow roll, startup, operation and coast-down, the system status will indicate vital information available at any time. The locations of various chiller parameters are clearly marked and instructions for specific operations are provided on many of the screens. Data can be displayed in either English or SI units.

Security access is provided to prevent unauthorized changes of setpoints. This is accomplished with three different levels of access and passwords for each level. There are certain screens, displayed values, programmable setpoints and manual controls not shown that are for servicing the chiller. They are only displayed when logged in at service access level. Included in this is the Advanced Diagnostics and troubleshooting information for the chiller and the panel.

The control center power supply is provided from a fused 2 KVA transformer located in the power panel.

The control center is also fused to provide individual over-current protected power for the remote mounted water pump motor starters (supplied by others) and the controls

installed on the chiller. Numbered terminal strips for wiring such as Remote Start / Stop, Chilled Water Pump and Local or Remote Cycling devices are provided. The Panel also provides field interlocks that indicate the chiller status. These contacts include a Remote Mode Ready-to-Start, a Controlled Shutdown, a Safety Shutdown and a chiller Run contact. System pressures are monitored with transmitters (4-20 mA) and transducers (0-5 VDC). System temperatures are monitored using thermistors and RTD's.

Setpoints can be changed from a remote location via 0-10VDC and 4-20mA, contact closures or through serial communications. The adjustable remote reset range [up to 20°F (11.1°C)] provides flexible, efficient use of remote signal depending on reset needs. Serial data interface to the YORK ISN Building Automation System (BAS) is through the optional Microgateway Card, which can be mounted inside the Control Center. Interfaces using other industry standard protocols such as MODBUS RTU, Johnson NZ, BACnet MS/TP, LONMARK and ASCII are available.

The operating program is stored in non-volatile memory to eliminate chiller failure due to AC power failure/battery discharge. Programmed setpoints are retained in lithium battery-backed RTC memory for 11 years minimum.

Smart Freeze Point Protection will run the chiller at 36°F (2.2°C) leaving chilled water temperature eliminating nuisance trips on Low Water Temperature. The sophisticated program and sensors will monitor the chiller water and evaporator refrigerant liquid temperatures to prevent freeze up. Every programmable point has a pop-up screen with the allowable ranges, so that the chiller can not be programmed to operate outside of its design limits.

The capacity control logic provides stable operation at maximum efficiency at off design conditions by modulating the turbine speed, compressor pre-rotation vanes and hot gas by-pass valve.

When the power is applied to the chiller, the HOME screen is displayed. This screen displays a visual representation of the chiller and a collection of data detailing important operations and parameters. The primary values that need to be monitored and controlled are shown on this screen. The owner can be confident that YORK's OptiView control system for the YST is unequalled in its design, control features and protection systems. See "Equipment Specifications" for a more detailed description of OptiView features.

Equipment Specifications

GENERAL

The YORK YST MAXE Centrifugal Liquid Chillers are completely factory-packaged including the evaporator, refrigerant condenser, compressor, steam turbine, lubrication systems, power panel, control center, and all interconnecting unit piping and wiring. The steam condenser package is shipped separately suitable for direct mounting onto the chiller or mounting along-side.

The initial charge of refrigerant and oil is supplied for each chiller. When the optional refrigerant condenser isolation valves are ordered, the unit may ship fully charged with refrigerant and oil. Actual shipping procedures will depend on a number of project-specific details.

The services of a YORK factory-trained, field service representative are incurred to supervise or perform the final leak testing, charging, the initial start-up, and concurrent operator instructions.

COMPRESSOR

The compressor is a single-stage centrifugal type powered by a steam turbine. The casing is fully accessible with vertical circular joints and fabricated of close-grain cast iron. The complete operating assembly is removable from the compressor and scroll housing. The rotor assembly consists of a heat-treated alloy steel drive shaft and impeller shaft with a high strength, cast aluminum alloy, fully shrouded impeller. The impeller is designed for balanced thrust and is dynamically balanced and overspeed tested for smooth, vibration free operation.

The insert-type journal and thrust bearings are fabricated of aluminum alloy and are precision bored and axially grooved. The specially engineered, single helical gears with crowned teeth are designed so that more than one tooth is in contact at all times to provide even distribution of compressor load and quiet operation. Gears are integrally assembled in the compressor rotor support and are film lubricated. Each gear is individually mounted in its own journal and thrust bearings to isolate it from impeller and turbine forces.

CAPACITY CONTROL

During part load operation at off design conditions, the chiller capacity is reduced to maintain a constant leaving chilled liquid temperature by first decreasing the speed, then closing the compressor pre-rotation vanes (PRV). This provides capacity reduction from 100% to 15% of design for normal air conditioning applications. The speed is controlled by a pneumatically actuated governor

valve which throttles the inlet steam flow to the turbine to maintain the speed dictated by the capacity control logic. If the tower water temperatures must be held above 75°F for other chillers, the capacity control logic automatically limits the amount of speed reduction and PRV closure to maintain stable operation. The hot gas by-pass valve is then modulated to maintain a constant leaving chilled liquid temperature with loads down to 10% of design.

The vanes are actuated by an external, electric PRV actuator. Rugged, airfoil shaped, cast manganese bronze vanes are precisely positioned by solid vane linkages connected to the electric actuator.

COMPRESSOR LUBRICATION SYSTEM

Lubrication oil is force-fed to all bearings, gears and rotating surfaces by a variable speed drive pump which operates prior to startup, continuously during operation and during coastdown. A gravity-fed oil reservoir is built into the top of the compressor to provide lubrication during coastdown in the event of a power failure.

An oil reservoir, separate from the compressor, contains the submersible oil pump, 2 HP pump motor and 3000 watt immersion-type oil heater. The oil heater is thermostatically controlled to remove refrigerant from the oil.

Oil is filtered by an externally mounted 1/2 micron replaceable cartridge oil filter equipped with service valves. Oil is cooled via a shell and tube, water cooled oil cooler sized to use refrigerant condenser water as the cooling medium. The oil side of the oil cooler is provided with service valves. Oil piping is completely factory-installed. The water side of the oil cooler is provided with service valves, inlet strainer and solenoid valve for automatic start/stop of cooling water flow. Water piping is factory installed with customer connections conveniently brought to the edge of the chiller package and clearly tagged for installation. An automatic oil return system recovers any oil that may have migrated to the evaporator. Oil temperature control is by an Amot, three way temperature control valve.

STEAM TURBINE

The steam turbine is a high efficiency multistage design operating at a nominal 4500 rpm design maximum speed.

The turbine is packaged on a driveline base, completely factory piped. The driveline base has a mating flange on shaft end of the package that will bolt directly to the compressor D-flange face providing a rigid interface

Equipment Specifications (continued)

between turbine package and compressor. Complete turbine/compressor driveline is factory aligned prior to shipment. Turbine drive shaft is directly connected to the compressor shaft with a flexible disc coupling. Coupling is of an all metal construction with no wearing parts assuring long life and no lubrication requirements providing low maintenance.

The turbine casing is horizontally split designed to allow longitudinal thermal expansion without the affecting alignment or efficiency of the turbine. The shaft and wheels are alloy steel with the wheels shrunk and keyed to the shaft. The turbine blades are 403 grade stainless steel and the shaft is ground throughout with stainless steel sprayed in the carbon ring end gland contact area. Stainless steel nozzles are furnished throughout the turbine. Carbon ring end gland and diaphragm seals are furnished. Turbine end gland carbon ring seals (minimum five seals per end gland) are separated by partitions of stainless steel. The end gland seals are arranged for the admission of sealing steam. Pressure reducing valves are provided to regulate the steam pressure from steam inlet pressure to the 1-3 psig (7-21 kPa) needed for the gland seal.

A stainless steel, inlet steam strainer with adequate size and mesh to minimize the pressure drop is supplied. Strainer is removable without breaking the steam piping connections.

Blanket insulation is furnished on the steam chest and barrel of the turbine for operator protection.

The turbine speed is controlled by a governor valve which is integrated with the chiller controls. The valve is of stainless steel with stainless steel seats and designed to control flow throughout the entire operating range of the turbine. The system employs an overspeed governor designed to close an independent high performance butterfly trip valve with a pneumatic actuator when the turbine speed exceeds 110 percent of the maximum continuous operating speed of the turbine. Activation of the independent trip valve causes the governor valve to also close. A micro switch is furnished on the trip linkage for the customer's use.

TURBINE LUBRICATION SYSTEMS

Ring Oil Lubricated Turbines - Drive powers less than 1700Hp (1268 kW) only

The bearings are steel backed, babbitt lined, split sleeve type. The design is such that the bottom half is removable with the shaft in place. The bearing housing has provisions for air purging of the housing shaft seals. The thrust bearing is an antifriction ball bearing,

accessible and removable without lifting the top half of the turbine casing. Oil cooling is by water cooled bearing housings.

External, Pressurized Lube System Turbines

The bearings are steel backed, babbitt lined, split sleeve type. The design is such that the bottom half is removable with the shaft in place. The bearing housing has provisions for air purging of the housing shaft seals. The thrust bearing is a double acting, Kingsbury type. The lubrication system is integral to the turbine driveline base and completely factory piped. The lubrication system consists of a shaft driven main oil pump, motor driven auxiliary oil pump, water cooled shell and tube oil cooler, 25 micron full flow oil filter and separate oil reservoir with level gauge. Oil temperature control is by an Amot, three way temperature control valve.

STEAM CONDENSER PACKAGE

A steam condenser is provided to condense exhaust steam at vacuum pressures to maintain efficient turbine operation. The steam condenser water circuit is piped in series with the refrigerant condenser, eliminating a separate cooling water circuit and is designed to minimize pressure drop for energy savings.

The steam condenser is furnished fully packaged. The package includes a single hotwell pump, a single liquid ring vacuum pump for air removal, atmospheric relief valve and level control system. The package is factory piped, wired and mounted on a common structural steel frame suitable for installation on the refrigerant condenser or floor mounting adjacent to the chiller system.

Condensate level is controlled by a level control system with two (2) pneumatic control valves - one for re-circulation and the other for removal of condensate. The liquid ring vacuum pump is capable of drawing the condenser down to operating pressure in approximately 10 minutes. Hotwell pump is single-stage, end suction suitable for hotwell service. Steam side is designed for 15 psig (100 kPa) and 30" Hg Vac (760 mmHg).

Atmospheric relief valve is a water seal type with external handwheel, sized in accordance with the Heat Exchange Institute Standards (HEI) for protection of the steam turbine exhaust, steam trunk and steam condenser.

All key control and monitoring parameters are integrated with the chiller control panel. In addition, auxiliary pressure gauges are located at the condenser steam inlet and condensate pump discharge piping, and temperature gauges are located at the steam inlet, cooling water inlet and outlet, and the hotwell.

To facilitate rigging, condenser is separable from the skid by unbolting. Piping is outfitted with unions at suitable break-points. Both condenser and skid are outfitted with lifting lugs for both vertical and horizontal lifting.

HEAT EXCHANGERS

Shells

Evaporator, refrigerant condenser and steam condenser shells are fabricated from rolled carbon steel plates with fusion welded seams. Carbon steel tube sheets, drilled and reamed to accommodate the tubes, are welded to the end of each shell. Intermediate tube supports are fabricated from carbon steel plates, drilled and reamed to eliminate sharp edges. The refrigerant side of each shell is designed, tested, and stamped in accordance with ASME Boiler and Pressure Vessel Code, Section VIII - Division I, or other pressure vessel code as appropriate. The steam side of the steam condenser is designed in accordance with the Heat Exchange Institute (HEI), an industry standard for steam condenser technology.

Tubes

Refrigerant heat exchanger tubes are state-of-the-art, high-efficiency, externally and internally enhanced type to provide optimum performance. Tubes in both the evaporator and refrigerant condenser are 3/4" O.D. (19 mm) copper alloy and utilize the "skip-fin" design, providing a smooth internal and external surface at each intermediate tube support. This provides extra wall thickness (up to twice as thick) and non-work hardened copper at the support location, extending the life of the heat exchangers. Each tube is roller expanded into the tube sheets providing a leak-proof seal, and is individually replaceable. Steam condenser tubes are copper, providing economical and efficient heat transfer.

Evaporator

The evaporator is a shell and tube, flooded type heat exchanger. A distributor trough provides uniform distribution of refrigerant over the entire shell length to yield optimum heat transfer. A suction baffle or aluminum mesh eliminators are located above the tube bundle to prevent liquid refrigerant carryover into the compressor. A 1-1/2" (38 mm) liquid level sight glass is conveniently located on the side of the shell to aid in determining proper refrigerant charge. The evaporator shell contains a dual refrigerant relief valve arrangement set at 180 psig (1241 kPa); or single-relief valve arrangement, if the chiller is supplied with the optional refrigerant isolation valves. A 3/4" (19 mm) flare male charging connection is provided.

Refrigerant Condenser

The refrigerant condenser is a shell and tube type, with a discharge gas baffle to prevent direct high velocity impingement on the tubes. The baffle is also used to distribute the refrigerant gas flow properly for most efficient heat transfer. An integral sub-cooler is located at the bottom of the refrigerant condenser shell providing highly effective liquid refrigerant subcooling to provide the highest cycle efficiency. The refrigerant condenser contains dual refrigerant relief valves set at 235 psig (1620 kPa).

Steam Condenser

Steam condenser construction is of the shell and tube type of welded steel construction with 3/4" OD (19 mm) prime surface copper tubes, roller-expanded into tube sheets. An impingement plate located below the centrally located steam inlet redirects steam flow to protect the tubes from high velocity steam. Subcooling sections in the condenser cool non-condensibles sufficiently below the condensing temperature thereby reducing the vacuum pump capacity required. Water side is suitable for a maximum working pressure of 150 psig (1030 kPa). An atmospheric relief valve, sized per HEI to protect the condenser, is included. This relief valve is set to open at 1-2 psig (7-14 kPa) and will prevent pressure in the condenser shell from exceeding 10 psig (69 kPa). Seal water is required to maintain a liquid seal in the valve. An inlet and overflow connection is provided on the valve for this purpose.

Water Boxes

The water boxes are fabricated from steel and are marine style (compact or marine available on evaporator). The standard design working pressure is 150 psig (1030 kPa) and the chiller boxes are tested at 225 psig (1550 kPa). Steam condenser boxes are tested at 215 psig (1480kPa). Integral steel water baffles are located and welded within the water box to provide the required pass arrangements. Stub-out water nozzle connections with Victaulic grooves are welded to the water boxes. These nozzle connections are suitable for Victaulic couplings, welding or flanges, and are capped for shipment. Plugged 3/4" NPTI (19 mm) drain and vent connections are provided in each water box.

REFRIGERANT FLOW CONTROL

Refrigerant flow to the evaporator is controlled by the YORK variable orifice control system. Liquid refrigerant level is continuously monitored to provide optimum subcooler, refrigerant condenser and evaporator performance. The variable orifice electronically adjusts to all Real-World operating conditions, providing the most efficient and reliable operation of refrigerant flow control.

Equipment Specifications (continued)

POWER PANEL

All motor contactors and circuit protectors, the compressor oil pump variable speed drive and the control power transformer are contained in an enclosure installed adjacent to the OptiView control center. A main power disconnect switch is supplied which provides the termination points for customer's single point power supply wiring.

OPTIVIEW CONTROL CENTER

General

The chiller is controlled by a stand-alone microprocessor based control center. The chiller control panel provides control of entire system, including turbine and steam condenser operation and monitoring.

The control panel includes a 10.4" diagonal color liquid crystal display (LCD) surrounded by "soft" keys which are redefined based on the screen displayed at that time, mounted in the middle of a keypad interface and installed in a locked enclosure. The screen details all operations and parameters, using a graphical representation of the chiller and its major components. Panel text is in English only. Data can be displayed in either English or Metric units. Additional features are:

- Smart Freeze Point Protection capable of running the chiller at 36°F (2.2°C) leaving chilled water temperature eliminating nuisance trips on low water temperature. The sophisticated program and sensors monitor the chiller water and evaporator refrigerant liquid temperatures to prevent freeze-up.
- The panel displays countdown timer messages so the operator knows when functions are starting and stopping. Every programmable point has a pop-up screen with the allowable ranges, so that the chiller can not be programmed to operate outside of its design limits.
- Security access is built in to prevent unauthorized change of setpoints, to allow local or remote control of the chiller, and to allow manual operation of the pre-rotation vanes and oil pump. Access is through ID and password recognition, which is defined by three different levels of user competence: view, operator, and service.
- Trending data is available with the ability to customize points from once every second to once every hour. The panel will trend up to 6 different parameters from a list of over 140, without the need of an external monitoring system.
- The operating program is stored in non-volatile memory to eliminate reprogramming the chiller due to AC power failure or battery discharge. Programmed setpoints are retained in lithium battery-

backed RTC memory for a minimum of 11 years with power removed from the system.

- Includes an RS-232 port to output all system operating data, shutdown/cycling message, and a record of the last 10 cycling or safety shutdowns to a field-supplied printer. Data logs to a printer at a set programmable interval. This data can be preprogrammed to print from 1 minute to 1 day.
- The text displayed within the system status and system details field is displayed as a color-coded message to indicate severity: red for safety fault, orange for cycling faults, yellow for warnings, and green for normal messages.

The chiller control panel provides a multitude of diagnostic and operating data too numerous to cover completely in this guide. However, a general description of some of the data available and examples of the various screens provided follows:

Some highlights (not all inclusive) of the data available on the panel are as follows:

SYSTEM OPERATING INFORMATION

Evaporator

- Leaving and return chilled water temperature
- Refrigerant liquid temperature - evaporator
- Evaporator pressure
- Hot gas control status
- Chilled water flow

Refrigerant Condenser

- Entering and leaving refrigerant condenser water temperature
- Refrigerant liquid temperature - refrigerant condenser
- Refrigerant condenser pressure
- Subcooler refrigerant liquid level
- Subcooler refrigerant liquid level control status
- Refrigerant condenser water flow

Compressor

- Compressor discharge temperature
- Compressor oil temperature
- Compressor supply oil pressure
- Compressor thrust bearing proximity probe gap (J compressors only)
- Pre-rotation vanes (PRV) position

Steam Turbine

- Turbine shaft end bearing temperature
- Turbine governor end bearing temperature

- Turbine inlet steam temperature
- Turbine inlet steam pressure
- Turbine first stage steam pressure
- Turbine exhaust pressure
- Turbine speed
- Turbine governor control status

Steam Condenser

- Hotwell condensate level
- Hotwell level control status

SAFETY SHUTDOWNS

(will prevent unit from starting or operating)

- Evaporator - low pressure
- Evaporator - low temperature (Smart Freeze Point Protection)
- Evaporator - transducer or leaving liquid probe failure
- Evaporator - transducer or temperature sensor failure
- Refrigerant condenser - high pressure contacts open
- Refrigerant condenser - high pressure
- Refrigerant condenser - pressure transducer out-of-range
- Compressor discharge - high temperature
- Compressor discharge - low temperature
- Compressor oil - high temperature
- Compressor oil - low differential temperature
- Compressor oil - high differential pressure
- Compressor oil - sump pressure transducer out-of-range
- Compressor oil - differential pressure calibration
- Compressor oil - variable speed pump - pressure setpoint not achieved
- Compressor thrust bearing - proximity probe uncalibrated (J compressors only)
- Compressor thrust bearing - proximity probe clearance (J compressors only)
- Compressor thrust bearing - proximity probe out-of-range (J compressors only)
- Control panel - power failure
- Turbine governor end bearing high temperature
- Turbine shaft end bearing high temperature
- Turbine oil - low pressure
- Turbine oil - high temperature
- Turbine underspeed
- Turbine exhaust high pressure
- Standby hotwell pump fault (warning on failure of primary pump)
- Standby vacuum pump - no sealing water flow (warning on failure of primary system)

- Standby vacuum pump fault (warning on failure of primary pump)
- Hotwell condensate high level
- Hotwell condensate low level

CODES AND STANDARDS

- ASME Boiler and Pressure Vessel Code - Section VIII Division 1.
- Heat Exchange Institute (HEI), Industry Standard for Steam Condensers
- NEMA (SM23) Steam Turbines for Mechanical Drive Services
- Expansion Joint Manufacturers Assoc., Inc. (EJMA)
- ARI Standard 550/590
- ASHRAE 15 - Safety Code for Mechanical Refrigeration
- ASHRAE Guideline 3 - Reducing Emission of Halogenated Refrigerants in Refrigeration and Air-Conditioning Equipment and Systems
- N.E.C. - National Electrical Code
- OSHA - Occupational Safety and Health Act

ISOLATION MOUNTING

The unit is provided with four vibration isolation mounts consisting of 1" (25.4 mm) thick neoprene isolation pads for field mounting under the steel mounting plates located on the tube sheets.

REFRIGERANT CONTAINMENT

The refrigerant circuit has been designed as a factory-packaged system. As such, it has minimum joints from which refrigerant can leak. The entire assembly has been thoroughly leak tested at the factory prior to shipment. The YORK chiller includes service valves conveniently located to facilitate transfer of refrigerant to a remote refrigerant storage/recycling system. Optional refrigerant condenser isolation valves allow storage of the charge in the refrigerant condenser.

PAINT

Exterior surfaces are protected with one coat of Caribbean blue, durable alkyd-modified, vinyl enamel, machinery paint.

SHIPMENT

Protective covering is furnished on the control center. Water nozzles are capped with fitted plastic enclosures. Entire unit is protected with industrial-grade, reinforced shrink-wrapped covering.

Accessories and Modifications

FLOOR MOUNTED STEAM CONDENSER

As an alternative to the standard packaged location, the steam condenser package can be ordered for floor mounting adjacent to the chiller package. Prefabricated piping kits for the steam trunk, water piping and wiring between chiller package and steam condenser are not included with a floor mounted arrangement. These interconnecting components must be designed, supplied and installed by customer.

Note: Interconnecting components may be ordered through the factory via a special quote upon request (site arrangement details will be required at time of request for quote).

AUTO-START CONTROL FEATURES

When this option is ordered, the chiller is provided with all components and programming for the OptiView micropanel to automatically control the start-up and shutdown of the system. All solenoids and automated components necessary for full automation are provided. Some parts will ship loose for installation at job site. An automatic pressure powered pump is also provided for draining condensate from the steam turbine casing during operation.

DUAL PUMPS FOR STEAM CONDENSER PACKAGE

Factory installed secondary (100% standby duty) condensate and vacuum pumps, including all interconnecting piping. Switchover of pumps is manual unless system auto-start option is ordered.

STEAM TURBINE CASING DRAIN OPTIONS

The steam turbine casing must be provided with a means of draining during operation (while under vacuum). Factory provided options for this function are:

- Automatic pressure powered pump
- Manual condensate drain tank (by special quote)
- Automatic condensate drain tank (by special quote)

Casing drain equipment is shipped loose for installation at job site.

FACTORY INSULATION

Factory-applied thermal insulation of the flexible, closed-cell plastic type, 3/4" (19 mm) thick is attached with vapor-proof cement to the evaporator shell, flow chamber, tube sheets, suction connection, and (as necessary) to the auxiliary tubing. Not included is the

insulation of compact water boxes and nozzles. This insulation will normally prevent condensation in environments with relative humidities up to 75% and dry bulb temperatures ranging from 50° to 90°F (10° to 32°C). 1-1/2" (38 mm) thick insulation is also available for relative humidities up to 90% and dry bulb temperatures ranging from 50° to 90°F (10° to 32°C). The turbine steam chest is insulated with a custom fitted, fiberglass insulating blanket for protection of personnel.

WATER FLANGES

150 psig (1030 kPa) ANSI raised-face flanges for refrigerant condenser, evaporator and steam condenser water connections, are factory-welded to water nozzles. Companion flanges, bolts, nuts and gaskets are not included.

MARINE WATER BOXES

Marine water boxes allow service access for cleaning of the heat exchanger tubes without the need to break the water piping. Bolted-on covers are arranged for convenient access. Victaulic nozzle connections are standard; flanges are optional. Marine water boxes are available for the evaporator.

Note: Marine water boxes are standard scope of supply on the refrigerant and steam condensers.

KNOCK-DOWN SHIPMENT

The chiller can be shipped knocked down into major subassemblies (evaporator, refrigerant condenser, driveline, etc.) as required to rig into tight spaces. This is particularly convenient for existing buildings where equipment room access does not allow rigging a factory-packaged chiller.

REFRIGERANT ISOLATION VALVES

Optional factory-installed isolation valves in the compressor discharge line and refrigerant liquid line are available. This allows isolation and storage of the refrigerant charge in the chiller refrigerant condenser during servicing, eliminating time-consuming transfers to remote storage vessels. Both valves are positive shut-off, assuring integrity of the storage system.

300 PSIG WATERSIDE DESIGN PRESSURE

Applications with greater than 150 psig (1030 kPa) water pressure can be accommodated by special quote upon request. Special design required for all heat exchanger water boxes and turbine/compressor cooling water circuits.

BAS NETWORK INTERFACE

A communication interface permitting complete exchange of chiller data with any BAS System is available with optional ISN MicroGateway. The MicroGateway also allows a BAS System to issue commands to the chiller to control its operation. All control data points are accessible to the BAS System. For full list of points, contact a York Controls Representative.

REFRIGERANT STORAGE / RECYCLING SYSTEM

A refrigerant storage/recycling system is a self-contained package consisting of a refrigerant compressor with oil separator, storage receiver, water-cooled condenser, filter drier and necessary valves and hoses to remove, replace and distill refrigerant. All necessary controls and safety devices are a permanent part of the system. Typically not required if unit isolation valves are provided.

Application Data

The following discussion is a user's guide in the application and installation of YST MAXE chillers to ensure the reliable, trouble-free life for which this equipment was designed. While this guide is directed towards normal, water-chilling applications, the YORK sales representative can provide complete recommendations on other types of applications.

LOCATION

YST MAXE chillers are virtually vibration free and may generally be located at any level in a building where the construction will support the total system operating weight.

The unit site must be a floor, mounting pad or foundation which is level within 1/4" (6 mm) and capable of supporting the operating weight of the unit.

Sufficient clearance to permit normal service and maintenance work should be provided all around and above the unit. Additional space should be provided at one end of the unit to permit cleaning of evaporator, refrigerant condenser and steam condenser tubes, as required. A doorway or other properly located opening may be used.

The chiller is designed to be installed in an indoor location where temperatures range from 40°F to 104°F (4.4°C to 40°C).

WATER PIPING

Flow Rate - For normal water chilling duty, evaporator and refrigerant condenser flow rates are permitted at water velocity levels in the heat exchangers tubes of between 3 ft/sec and 12 ft/sec (0.9 m/s and 3.7 m/s). Variable flow applications are possible, however, chiller selections must be made using a water velocity within the range noted above. Variable flow in the refrigerant condenser is not recommended, as it generally raises the energy consumption of the system by keeping the refrigerant condenser pressure high in the chiller. Additionally, the rate of fouling in the refrigerant condenser will increase at lower water velocities associated with variable flow, raising system maintenance costs. Cooling towers typically have narrow ranges of operation with respect to flow rates and will be more effective with full design flow. Ref. Table 1 for flow limits.

Temperature Ranges - For normal water chilling duty, leaving chilled water temperatures may be selected between 38°F (3.3°C) [36°F (2.2°C) with Smart Freeze enabled] and 70°F (21°C) for water temperature ranges between 3°F and 30°F (1.7°C and 16.7°C).

Water Quality – The practical and economical application of liquid chillers requires that the quality of the water supply for the condensers and evaporator be

analyzed by a water treatment specialist. Water quality may affect the performance of any chiller through corrosion, deposition of heat-resistant scale, sedimentation or organic growth. These will degrade chiller performance and increase operating and maintenance costs. Normally, performance may be maintained by corrective water treatment and periodic cleaning of tubes. If water conditions exist which cannot be corrected by proper water treatment, it may be necessary to provide a larger allowance for fouling, and/or to specify special materials of construction.

General Piping – All chilled water and condenser water piping should be designed and installed in accordance with accepted piping practice. Chilled water and condenser water pumps should be located to discharge through the chiller to assure positive pressure and flow through the unit. Piping should include offsets to provide flexibility and should be arranged to prevent drainage of water from the evaporator and condenser when the pumps are shut off. Piping should be adequately supported and braced independently of the chiller to avoid the imposition of strain on chiller components. Hangers must allow for alignment of the pipe. Isolators in the piping and in the hangers are highly desirable in achieving sound and vibration control.

Convenience Considerations – To facilitate the performance of routine maintenance work, some or all of the following steps may be taken by the purchaser:

Heat exchanger water boxes are equipped with plugged vent and drain connections. If desired, vent and drain valves may be installed with or without piping to an open drain. Pressure gauges with stop cocks and stop valves may be installed in the inlets and outlets of the condensers and chilled water line as close as possible to the chiller. An overhead monorail or beam may be used to facilitate servicing.

Connections – The standard chiller is designed for 150 psig (1030 kPa) design working pressure in both the chilled water and condenser water circuits. The connections (water nozzles) to these circuits are furnished with grooves for Victaulic couplings. Piping should be arranged for ease of disassembly at the unit for tube cleaning. All water piping should be thoroughly cleaned of all dirt and debris before final connections are made to the chiller.

Chilled Water – A water strainer of maximum 1/8" (3 mm) perforated holes must be field-installed in the chilled water inlet line as close as possible to the chiller. If located close enough to the chiller, the chilled water pump may be protected by the same strainer. The loss or severe reduction of water flow due to tube blockage could seriously impair the chiller performance or even result in tube freeze-up.

Condenser Water – The chiller is engineered for maximum efficiency at both design and part load operation by taking advantage of the colder cooling tower water temperatures which naturally occur during the winter months. Appreciable power savings are realized from these reduced heads.

The minimum entering condenser water temperature is provided by the following equation:

$$\text{In } ^\circ\text{F: minCondWT} = \text{LChilledWT} - \text{CondRange} \times (\text{PCTLoad}/100) + 5 + 12 \times (\text{PctLoad}/100)$$

$$\text{In } ^\circ\text{C: minCondWT} = \text{LChilledWT} - \text{CondRange} \times (\text{PCTLoad}/100) + (5 + 12 \times (\text{PctLoad}/100))/1.8$$

where:

minCondWT = entering condenser water temperature

LChilledWT = leaving chilled water temperature

CondRange = condenser water temperature range at design.

PCTLoad = chiller load as % design

At initial startup, entering condensing water temperature may be as much as 25°F (14°C) colder than the standby chilled water temperature as long as it is above the minimum entering condenser water temperature allowed.

A water strainer of maximum 1/8" (3 mm) perforated holes is recommended to be field-installed in the refrigerant condenser water inlet line as close as possible to the chiller. If located close enough to the chiller, the condenser water pump may be protected by the same strainer. The loss or severe reduction of water flow due to tube blockage could seriously impair the chiller performance.

STEAM AND CONDENSATE PIPING

Turbine supply steam and condensate piping connections to the chiller are to be supplied and installed by the site piping contractor. In addition, the turbine exhaust to the steam condenser shall be installed by the piping contractor, however, the design and supply of components may be supplied by YORK depending on the options chosen. Piping should be adequately supported and braced independently of the chillers. Hangers must allow for piping alignment at the operation temperature. Piping contractor is responsible for the fit and form of the turbine steam piping. The piping must be installed with the flanges and bolt holes properly aligned. The bolts should be able to be inserted without any difficulty and no force should be applied to allow the bolts to be inserted or flanges aligned. When the flange bolts are tightened, they must not impose any force or moment on the turbine flanges. Contact your local YORK office for any additional information.

RELIEF PIPING

Refrigerant Relief

Each chiller is equipped with dual pressure relief valves on the refrigerant condenser and two dual relief valves on the evaporator, or two single relief valves on the evaporator if the optional refrigerant isolation valves are ordered. The dual relief valves on the refrigerant condenser are redundant and allow changing of either valve while the unit is fully charged. The purpose of the relief valves is to quickly relieve excess pressure of the refrigerant charge to the atmosphere, as a safety precaution in the event of an emergency such as fire. They are set to relieve at an internal pressure as noted on the pressure vessel data plate, and are provided in accordance with ASHRAE 15 safety code and ASME or applicable pressure vessel code.

Sized to the requirements of applicable codes, a vent line must run from the relief device to the outside of the building. This refrigerant relief piping must include a cleanable, vertical-leg dirt trap to catch vent-stack condensation. Vent piping must be arranged to avoid imposing a strain on the relief connection and should include one flexible connection.

Steam Relief

Each steam condenser is equipped with an atmospheric relief valve, sized to relieve all the steam which can be admitted to a turbine under maximum possible full throttle conditions. The atmospheric relief valve is designed/selected per HEI standards for steam condensers and provides protection for the steam turbine exhaust and exhaust trunk, as well as the steam condenser shell. The discharge of the atmospheric relief valve should be piped to direct a large volumetric flow of hot steam to a safe area, away from all personnel.

SOUND AND VIBRATION CONSIDERATIONS

A YST MaxE chiller is not a source of objectionable sound and vibration in normal air conditioning applications. Neoprene isolation mounts are furnished as standard with each unit.

YST MaxE chiller sound pressure level ratings will be furnished on request.

Control of sound and vibration transmission must be taken into account in the equipment room construction as well as in the selection and installation of the equipment.

THERMAL INSULATION

No appreciable operating economy can be achieved by thermally insulating the chiller. However, the chiller's cold surfaces should be insulated with a vapor barrier insulation sufficient to prevent condensation. A chiller

Application Data (continued)

can be factory-insulated with 3/4" (19 mm) or 1-1/2" (38 mm) thick insulation, as an option. This insulation will normally prevent condensation in environments with dry bulb temperatures of 50°F to 90°F (10°C to 32°C) and relative humidities up to 75% [3/4" (19 mm) thickness] or 90% [1-1/2" (38 mm) thickness]. The insulation is painted and the surface is flexible and reasonably resistant to wear. It is intended for a chiller installed indoors and, therefore, no protective covering of the insulation is usually required. If insulation is applied to the water boxes at the job site, it must be removable to permit access to the tubes for routine maintenance. The turbine steam chest is factory insulated with a custom fitted, fiberglass insulating blanket for protection of personnel. The blanket is removable for maintenance access to the turbine.

VENTILATION

The ASHRAE Standard 15 Safety Code for Mechanical Refrigeration requires that all machinery rooms be vented to the outdoors utilizing mechanical ventilation by one or more power-driven fans. This standard, plus National Fire Protection Association Standard 90A, state, local and any other related codes should be reviewed for specific requirements. Since the YST MaxE chiller uses steam, ventilation should allow for the removal of heat radiated from the steam turbine.

In addition, the ASHRAE Standard 15 requires a refrigerant vapor detector to be employed for all refrigerants. It is to be located in an area where refrigerant from a leak would be likely to concentrate. An alarm is to be activated and the mechanical ventilation started at a value no greater than the TLV (Threshold Limit Value) of the refrigerant.

CUSTOMER CONNECTIONS/INTERFACES (See product drawings for connection sizes)

Water/Drains

- Refrigerant condenser inlet/outlet**
- Evaporator inlet/outlet
- Turbine/Compressor cooling water manifold inlet/outlet
- Steam condenser inlet**/outlet
- Steam condenser vacuum pump seal water: 3.5 gpm (0.2 L/s) @ approx. 60°F (15.6 °C)
- Steam condenser vacuum pump discharge separator drain
- Steam condenser relief valve seal water: trickle flow
- Steam condenser relief valve seal water drain
- Steam turbine casing drain
- Steam turbine gland leak off drain
- Steam turbine steam ring drain
- Steam condenser condensate overboard valve: [note: approx. 20 psig (138 kPa) discharge pres-

sure available at outlet of overboard valve. If downstream pressure requirements exceed this, a custom condensate pump selection is required.]

- Steam condenser hotwell level system drain
- Water box drains - evaporator, refrigerant condenser and steam condenser

**York provided pre-fabricated piping for these connections

Steam/Vents

- Steam turbine steam inlet
- Steam turbine steam exhaust**
- Steam condenser steam inlet**
- Steam condenser relief valve vent
- Steam turbine gland sealing steam: 150 psig (1030 kPa) max. steam supply
- Steam turbine gland seal relief valve

**York provided pre-fabricated piping for these connections

Refrigerant Vents

- Refrigerant condenser relief valves(s)
- Evaporator relief valve(s)

Air (Instrument Quality Air Source - ISA S7.3)

- Steam turbine governor air supply and bearing seal air purge: 80-150 psig (552 - 1030 kPa), approx. 13 SCFM (22 sm³/h).
- Steam condenser level control system: 20-150 psig (138 - 1030 kPa), approx. 0.5 SCFM (0.9 sm³/h).

Power

- 460V single point power connection, approximately 28.6 KVA (KD turbine) or 24.2 KVA (KG turbine).

Required Auxiliary Components (customer supplied)

- Steam inlet strainer: Full flow strainer with fine [3/64" (1.2 mm) perforations], stainless steel mesh, suitable for steam service.
- Steam inlet moisture separator: Steam supply to turbine must be dry & saturated for optimum efficiency.
- Steam inlet throttling valve: Manual globe valve for inlet steam isolation and throttling (during start up). Note: This valve is York supplied when the system auto-start option is ordered.
- Steam turbine casing drain options: The steam turbine casing must be provided with a means of draining during operation (while under vacuum). Customer options for this function are an automatic pressure powered pump, a manual condensate drain tank or an automatic condensate drain tank.

Note: An automatic pressure powered pump is York supplied when the system auto-start option is ordered.

TABLE 1 – WATER FLOW RATE LIMITS (GPM)

MODEL	EVAPORATOR						CONDENSER			
	1 PASS		2 PASS		3 PASS		1 PASS		2 PASS	
	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX
GB	1,735	6,938	867	3,469	578	2,313	2,551	10,205	1,276	5,102
GC	1,940	7,762	970	3,881	647	2,587	—	—	—	—
GD	2,220	8,879	1,110	4,439	740	2,960	3,008	12,034	1,504	6,017
HB	—	—	—	—	—	—	3,469	13,874	1,734	6,937
HD	—	—	—	—	—	—	3,773	15,094	1,887	7,547
HF	2,008	8,032	1,004	4,016	669	2,677	—	—	—	—
HH	2,346	9,384	1,173	4,692	782	3,128	—	—	—	—
JB	—	—	—	—	—	—	4,307	17,227	2,153	8,614
JD	—	—	—	—	—	—	4,785	19,141	2,393	9,571
JF	2,743	10,972	1,372	5,486	914	3,657	—	—	—	—
JG	2,978	11,913	1,489	5,956	993	3,971	—	—	—	—
JH	3,210	12,842	1,605	6,421	1,070	4,281	—	—	—	—
TB	—	—	—	—	—	—	4,307	17,227	2,153	8,614
TD	—	—	—	—	—	—	4,785	19,141	2,393	9,571
TF	2,743	10,972	1,372	5,486	914	3,657	—	—	—	—
TG	2,978	11,913	1,489	5,956	993	3,971	—	—	—	—
TH	3,210	12,842	1,605	6,421	1,070	4,281	—	—	—	—
VB	—	—	—	—	—	—	5,471	21,885	2,736	10,942
VD	—	—	—	—	—	—	6,796	24,469	3,398	12,235
VF	3,513	14,053	1,757	7,027	1,171	4,684	—	—	—	—
VH	3,843	15,370	1,921	7,685	1,281	5,123	—	—	—	—
WF	4,389	17,558	2,195	8,779	1,463	5,853	—	—	—	—
WH	5,139	20,556	2,570	10,278	1,713	6,852	—	—	—	—

TABLE 1A – WATER FLOW RATE LIMITS (L/S)

MODEL	EVAPORATOR						CONDENSER			
	1 PASS		2 PASS		3 PASS		1 PASS		2 PASS	
	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX	MIN	MAX
GB	109	438	55	219	36	146	161	644	80	322
GC	122	490	61	245	41	163	—	—	—	—
GD	140	560	70	280	47	187	190	759	95	380
HB	—	—	—	—	—	—	219	875	109	438
HD	—	—	—	—	—	—	238	952	119	476
HF	127	507	63	253	42	169	—	—	—	—
HH	148	592	74	296	49	197	—	—	—	—
JB	—	—	—	—	—	—	272	1,087	136	544
JD	—	—	—	—	—	—	302	1,208	151	604
JF	173	692	87	346	58	231	—	—	—	—
JG	188	752	94	376	63	251	—	—	—	—
JH	203	810	101	405	68	270	—	—	—	—
TB	—	—	—	—	—	—	272	1,087	136	544
TD	—	—	—	—	—	—	302	1,208	151	604
TF	173	692	87	346	58	231	—	—	—	—
TG	188	752	94	376	63	251	—	—	—	—
TH	203	810	101	405	68	270	—	—	—	—
VB	—	—	—	—	—	—	345	1,381	173	690
VD	—	—	—	—	—	—	386	1,544	193	772
VF	222	887	111	443	74	296	—	—	—	—
VH	242	970	121	485	81	323	—	—	—	—
WF	277	1,108	138	554	92	369	—	—	—	—
WH	324	1,297	162	649	108	432	—	—	—	—




Application Data (continued)

TABLE 2 – AVAILABLE COMPRESSOR/SHELL/TURBINE/STEAM CONDENSER MODELS

COMPRESSOR CODE	EVAPORATOR CODE	CONDENSER CODE	TURBINE MODEL	STEAM CONDENSER MODEL
H6, H7	GB, GC, GD	GB, GD	K2G51000090	29168A
			K2G51000125	29168B
J1	HF, HH	GB, GD	K2G71000090	29168C
			K2G71000125	29168D
J2	HF, HH	GB, GD HB, HD	KG81250090	31168B
			K2G71250125	31168C 31168D
J3	JF, JG, JH	JB, JD	KG81620090	35168B
			K2G71620125	35168C
			KD71620090	35168D
			KD71620125	
J4	TF, TG, TH	TB, TD	KD71620090	33192B 33192C 33192D
	VF, VH	VB, VD	KD71620125	
	WF, WH	VB, VD	KD71750090 KD71750125	

Dimensions (Ft. - In.) – Unit

H COMPRESSOR UNITS

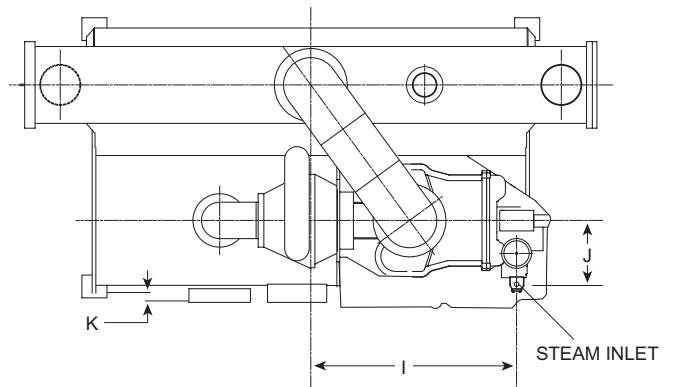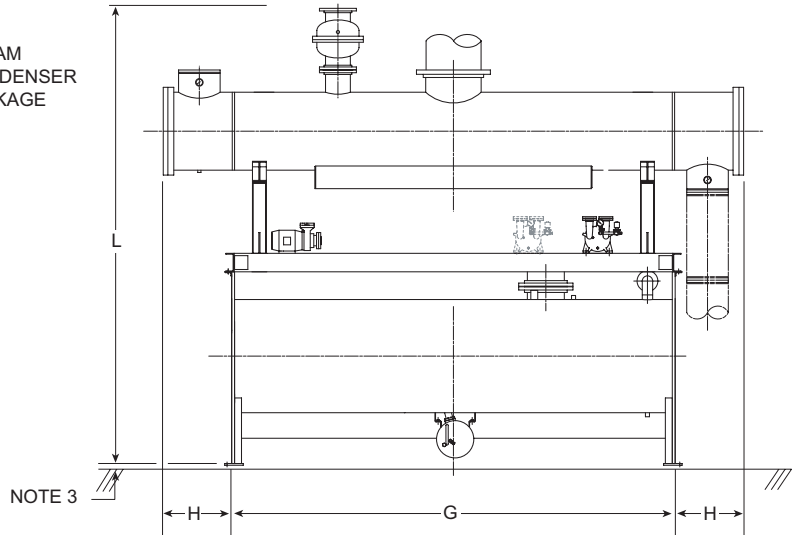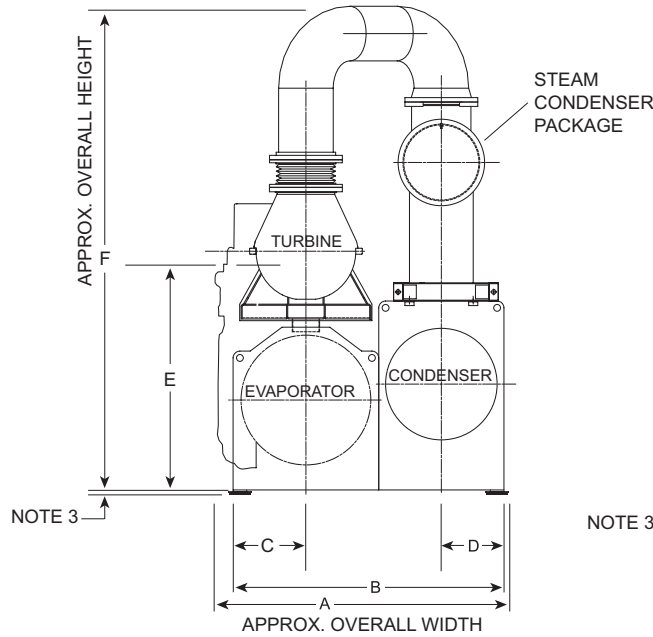

LD08000

H6/H7 COMPRESSOR (G-G SHELLS)	
KG Steam Turbine / 29168 Steam Condenser	
Dimension Code	ft-Inches
A	8'-8-1/2"
B	7'-8-1/2"
C	2'-1-1/4"
D	1'-9"
E w/4" strm inlet	7'-5/8"
E w/6" strm inlet	6'-11-3/8"
F	15'-9"
G	14'-0"
I	6'-5-15/16"
J w/4" strm inlet	1'-9-3/16"
J w/6" strm inlet	2'-2-3/16"
K	0'-1-3/4"
L	14'-7"

DIMENSION "H" FOR H6/H7 COMPRESSOR MODELS		
Steam Condenser Model 29168		
	1 Pass Refrig. Cond.	2 Pass Refrig. Cond.
Shell Code	ft-inches	ft-inches
GG	26'-15/16"	25'-5/16"


NOTES:

1. All dimensions are approximate. Certified dimensions are available on request.
2. Add 1/2" to nozzle length for flanged connections.
3. Add 1-3/4" for neoprene pads or 3/4" if neoprene pads are not supplied.

Dimensions (Ft. - In.) – Nozzle Arrangements


EVAPORATORS – COMPACT WATER BOXES – H COMPRESSOR UNITS

1-PASS

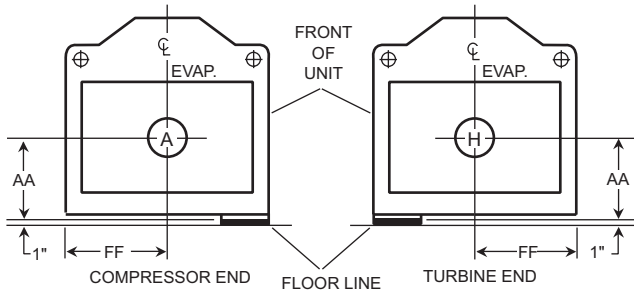

NOZZLE ARRANGEMENTS		
NO. OF PASSES	EVAPORATOR	
	IN	OUT
1	A H	H A


2-PASS

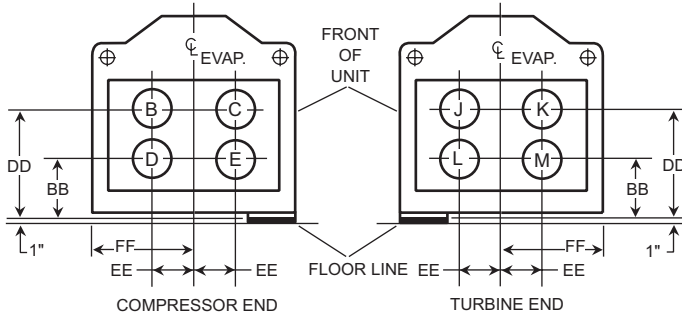

NOZZLE ARRANGEMENTS		
NO. OF PASSES	EVAPORATOR	
	IN	OUT
2	D E L M	C B K J

SHELL CODE
G

3-PASS

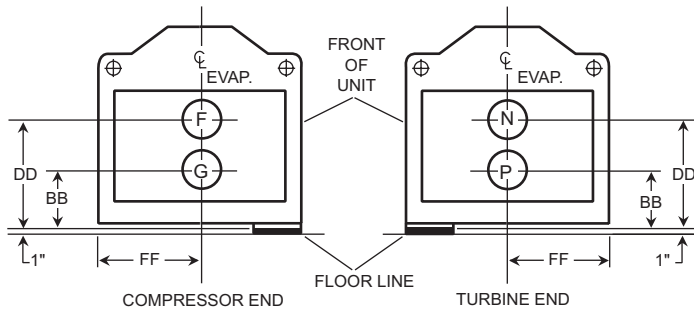


NOZZLE ARRANGEMENTS		
NO. OF PASSES	EVAPORATOR	
	IN	OUT
3	G P	N F

LD07986

EVAP. SHELL CODE	NOZZLE PIPE SIZES			EVAPORATOR NOZZLE DIMENSIONS								
	NO. OF PASSES			1-PASS			2-PASS			3-PASS		
	1	2	3	AA ⁵	FF	BB ⁵	DD ⁵	EE	FF	BB ⁵	DD ⁵	FF
G	16"	12"	10"	1'-9-5/8"	2'-1-1/4"	1'-3-5/8"	2'-3-5/8"	10-3/4"	2'-1-1/4"	1'-0-5/8"	2'-6-5/8"	2'-1-1/4"



2 PASS
RETURN HEAD

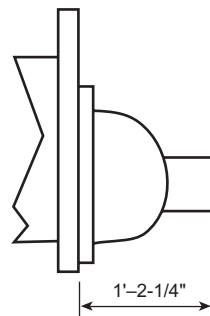


NOZZLE HEAD

LD08639


EVAPORATORS – MARINE WATER BOXES – H COMPRESSOR UNITS

2-PASS

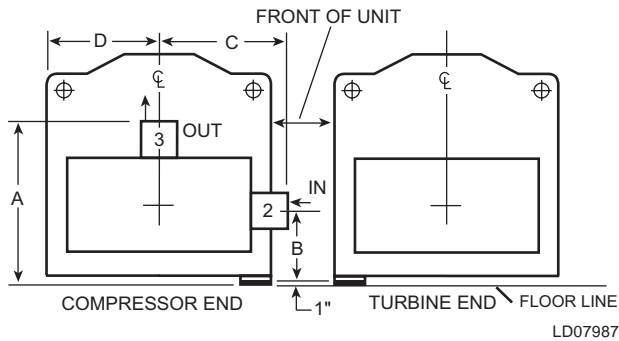

EVAP. SHELL CODE	EVAPORATOR NOZZLE DIMENSIONS			
	2-PASS			
	A ⁵	B ⁵	C	D
G	3'-10-1/8"	1'-4-3/4"	2'-7"	2'-1-1/4"

EVAPORATOR	
2-PASS	
IN	OUT
2	3

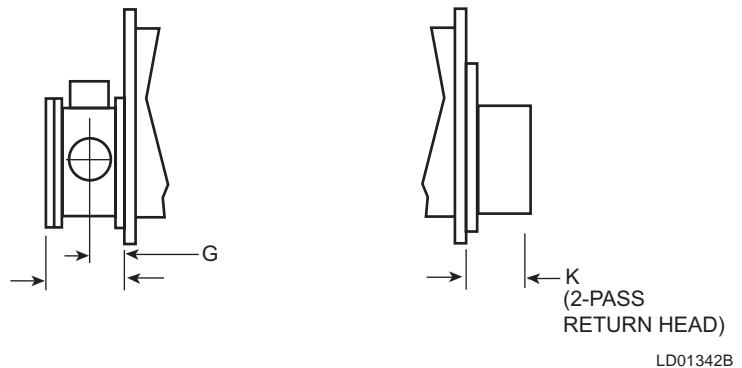

EVAPORATOR SHELL CODE	NOZZLE PIPE SIZE NO. OF PASSES
G	2 12"


EVAPORATOR SHELL CODE	EVAPORATOR NOZZLE DIMENSIONS (2-PASS)		
	G	H	K
G	11-1/4"	2'-0-3/8"	6-1/4"

NOTES:

1. All dimensions are approximate. Certified dimensions are available upon request.
2. Standard water nozzles are Schedule 40 pipe size, furnished as welding stub-outs with Victaulic grooves, allowing the option of welding, flanges, or use of Victaulic couplings. Factory-installed, class 150 (ANSI B16.5, round slip-on, forged carbon steel with 1/16" raised face), water flanged nozzles are optional (add 1/2" to nozzle length). Companion flanges, nuts, bolts, and gaskets are not furnished.
3. Any pair of evaporator nozzles may be used in combination with any pair of condenser nozzles. Compact water boxes on one heat exchanger may be used with Marine Water Boxes on the other heat exchanger.
4. Water must enter the water box through the bottom connection to achieve rated performance.
5. Add 1" if neoprene pads are supplied.

Dimensions (Ft. - In.) – Nozzle Arrangements

CONDENSERS – MARINE WATER BOXES – H COMPRESSOR UNITS

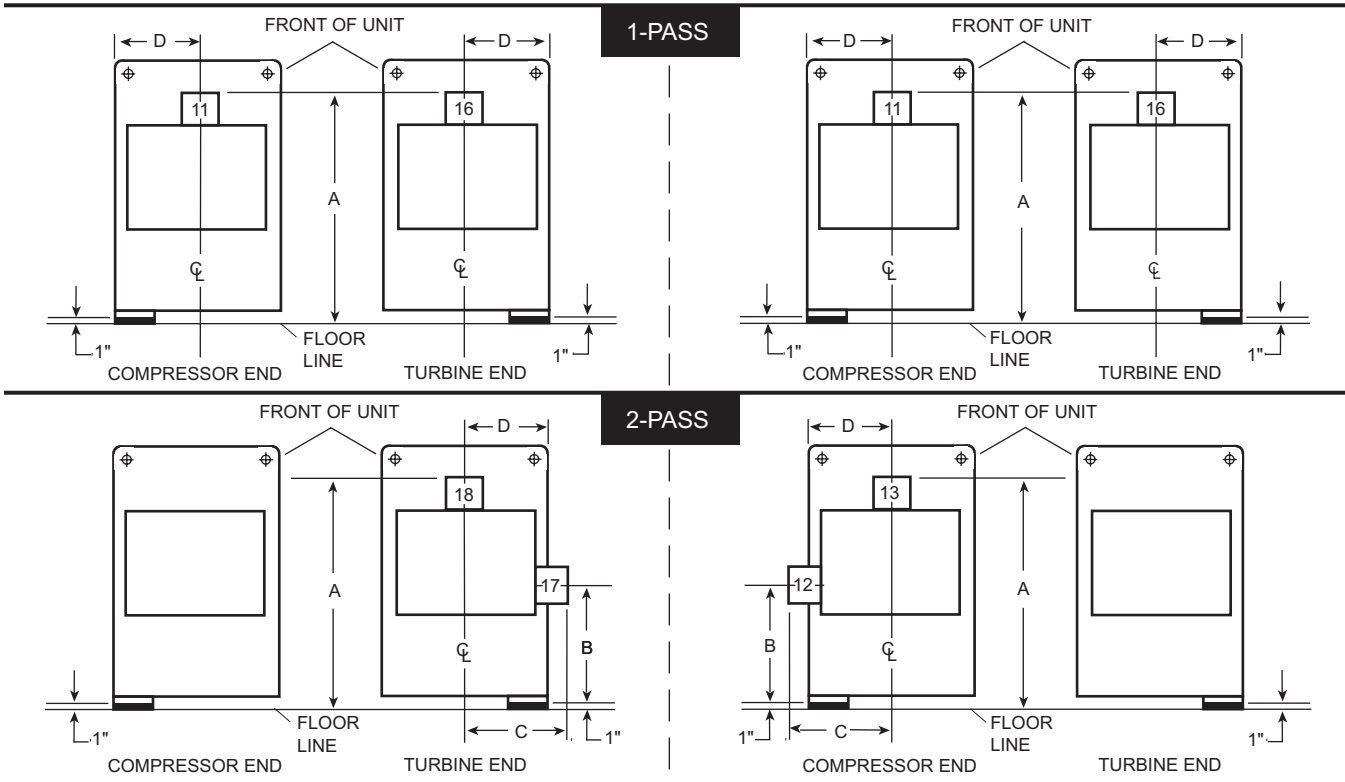


LD07988

COND. SHELL CODE	CONDENSER NOZZLE DIMENSIONS					
	1-PASS		2-PASS			
	A ⁵	D	A ⁵	B ⁵	C	D
G	5'-9-7/8"	1'-9"	5'-8-7/8"	2'-8-3/4"	2'-4-1/8"	1'-9"

See Notes on page 23.

Dimensions (Ft. - In.) – Nozzle Arrangements

CONDENSER	
1-PASS	
IN	OUT
11	16
16	11

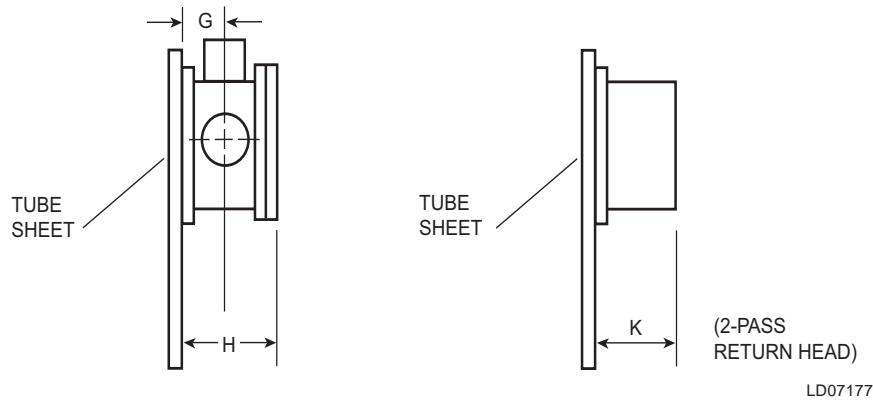

CONDENSER	
2-PASS	
IN	OUT
12	13
17	18

CONDENSER SHELL CODE	COND. NOZZLE DIMENSIONS (1-PASS)	
	G	H
G	1'-1-1/4"	2'-4-3/8"

COND. SHELL CODE	NOZZLE PIPE SIZE NO. OF PASSES	
	1	2
G	16"	14"




CONDENSER SHELL CODE	COND. NOZZLE DIMENSIONS (2-PASS)		
	G	H	K
G	1'-0-1/4"	2'-2-3/8"	6"

NOTES (see chart on page 22):

1. All dimensions are approximate. Certified dimensions are available upon request.
2. Standard water nozzles are Schedule 40 pipe size, furnished as welding stub-outs with Victaulic grooves, allowing the option of welding, flanges, or use of Victaulic couplings. Factory-installed, class 150 (ANSI B16.5, round slip-on, forged carbon steel with 1/16" raised face), water flanged nozzles are optional (add 1/2" to nozzle length). Companion flanges, nuts, bolts, and gaskets are not furnished.
3. One- and two- nozzle arrangements are available only in pairs shown and for all shell codes. Any pair of evaporator nozzles may be used in combination with any pair of condenser nozzles. Compact water boxes on one heat exchanger may be used with Marine Water Boxes on the other heat exchanger.
4. Condenser water must enter the water box through the bottom connection for proper operation of the sub-cooler to achieve rated performance.
5. Add 1" if neoprene pads are supplied.

Dimensions (Ft. - In.) – Unit

J COMPRESSOR UNITS

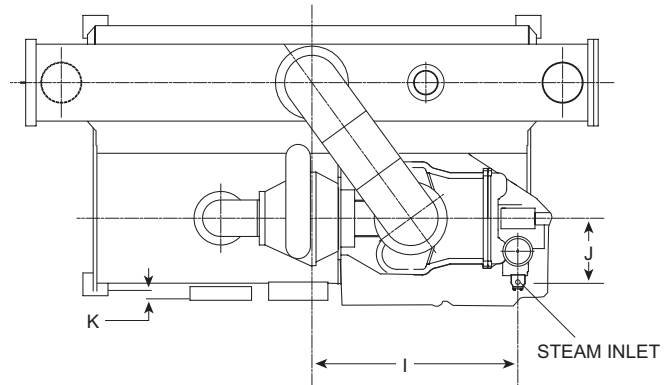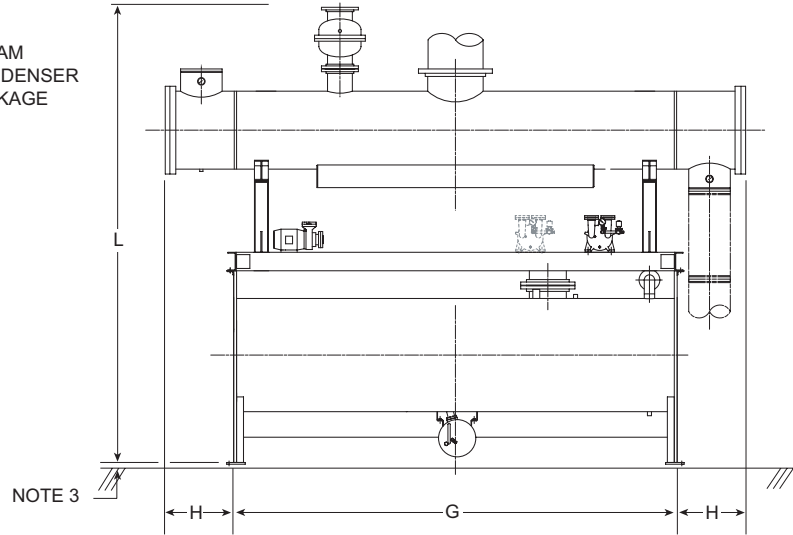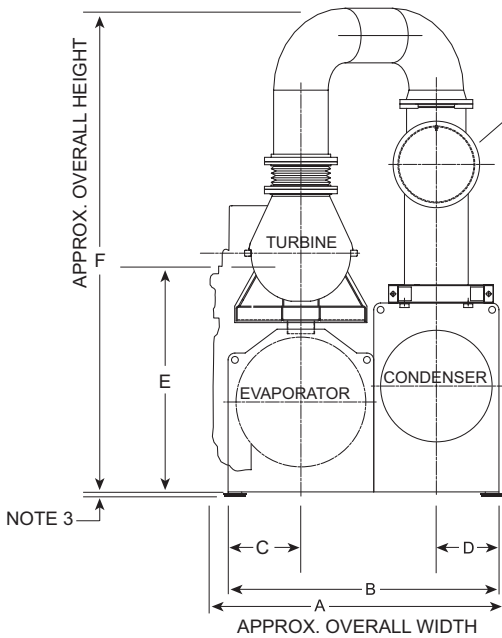

LD08000

J1 COMPRESSOR (H-G SHELLS)	
KG Steam Turbine/29168 Steam Condenser	
Dimension Code	ft-Inches
A	8'-11-1/4"
B	7'-10-1/2"
C	2'-2-1/4"
D	1'-9"
E w/4" stm inlet	6'-11-3/4"
E w/6" stm inlet	6'-10-1/2"
F	15'-9"
G	14'-0"
I	6'-8-1/4"
J w/4" stm inlet	1'-9-3/16"
J w/6" stm inlet	2'-2-3/16"
K	0'-3-3/4"
L	14'-7"

J2 COMPRESSOR		
KG Steam Turbine/31168 Steam Condenser		
Shell Code	HG	HH
Dimension Code	ft-inches	ft-inches
A	8'-11-1/4"	9'-2"
B	7'-10-1/2"	8'-2-1/2"
C	2'-2-1/4"	2'-2-1/4"
D	1'-9"	1'-11"
E w/4" stm inlet	6'-11-3/4"	6'-14-3/4"
E w/6" stm inlet	6'-10-1/2"	6'-13-1/2"
F	15'-11"	16'-3"
G	14'-0"	14'-0"
I	6'-8-1/4"	6'-8-3/8"
J w/4" stm inlet	1'-9-3/16"	1'-9-3/16"
J w/6" stm inlet	2'-2-3/16"	2'-2-3/16"
K	0'-3-3/4"	0'-3-3/4"
L	14'-8-15/16"	15'-0-15/16"

NOTES:

1. All dimensions are approximate. Certified dimensions are available on request.
2. Water nozzles can be located on either end of unit. Add 1/2" to nozzle length for flanges connections.
3. Add 1-3/4" for neoprene pads or 3/4" if neoprene pads are not supplied.

J3 COMPRESSOR (J-J Shells)		
35168 Steam Condenser		
	KG Steam Turbine	KD Steam Turbine
Dimension Code	ft-inches	ft-inches
A	10'-0"	10'-2"
B	9'-1"	9'-1"
C	2'-5-1/2"	2'-5-1/2"
D	2'-1"	2'-1"
E w/4" stm inlet	7'-8-3/4"	7'-7-1/2"
E w/6" stm inlet	7'-7-1/2"	7'-7-1/2"
F	17'-7"	17'-7"
G	14'-0"	14'-0"
I	6'-7-1/2"	TBD
J w/4" stm inlet	1'-9-3/16"	2'-5-1/4"
J w/6" stm inlet	2'-2-3/16"	2'-5-7/16"
K	0'-4-1/2"	0'-4-1/2"
L	15'-10"	15'-10"


J4 COMPRESSOR			
KD Steam Turbine/33192 Steam Condenser			
Shell Code	TT	VV	WV
Dimension Code	ft-inches	ft-inches	ft-inches
A	10'-2"	10'-5"	10'-9"
B	9'-1"	9'-6"	9'-11"
C	2'-5-1/2"	2'-5-1/2"	2'-8"
D	2'-1"	2'-3-1/2"	2'-3-1/2"
E w/4" stm inlet	7'-9-1/2"	7'-11-1/2"	8'-2"
E w/6" stm inlet	7'-9-1/2"	7'-11-1/2"	8'-2"
F	17'-4"	17'-9"	17'-9"
G	16'-0"	16'-0"	16'-0"
I	TBD	TBD	TBD
J w/4" stm inlet	2'-5-1/4"	2'-5-1/4"	2'-5-1/4"
J w/6" stm inlet	2'-5-7/16"	2'-5-7/16"	2'-5-7/16"
K	0'-4-1/2"	0'-4-1/2"	0'-4"
L	16'-0-1/8"	16'-5-1/8"	16'-5-1/8"

DIMENSION "H" FOR ALL J COMPRESSOR MODELS		
Steam Condenser Model 29168		
	1 Pass Refrig. Cond.	2 Pass Refrig. Cond.
Shell Code	ft-inches	ft-inches
HG	26-15/16"	25-5/16"
Steam Condenser Model 31168		
	1 Pass Refrig. Cond.	2 Pass Refrig. Cond.
Shell Code	ft-inches	ft-inches
HG	27-5/16"	25-11/16"
HH	31-11/16"	27-13/16"
Steam Condenser Model 35168		
	1 Pass Refrig. Cond.	2 Pass Refrig. Cond.
Shell Code	ft-inches	ft-inches
JJ	32-3/16"	28-5/16"
Steam Condenser Model 33192		
	1 Pass Refrig. Cond.	2 Pass Refrig. Cond.
Shell Code	ft-inches	ft-inches
TT	31-15/16"	28-1/16"
VV	31-15/16"	29-5/8"
WV	31-15/16"	29-5/8"

Dimensions (Ft. - In.) – Nozzle Arrangements


EVAPORATORS – COMPACT WATER BOXES – J COMPRESSOR UNITS

1-PASS

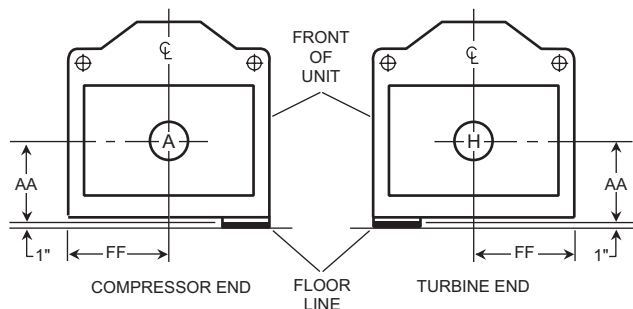


NOZZLE ARRANGEMENTS		
NO. OF PASSES	EVAPORATOR	
	IN	OUT
1	A	H
	H	A

2-PASS

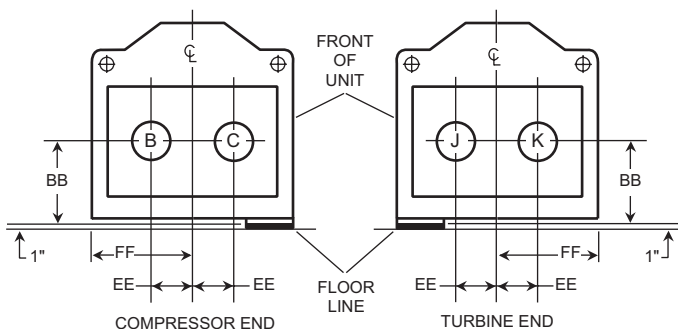

NOZZLE ARRANGEMENTS		
NO. OF PASSES	EVAPORATOR	
	IN	OUT
2	B	C
	C	B
	J	K
	K	J

3-PASS

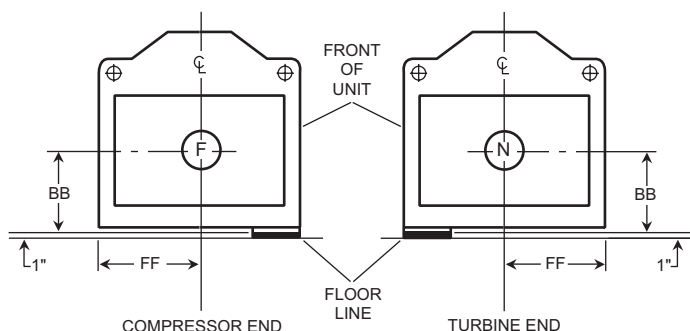

NOZZLE ARRANGEMENTS		
NO. OF PASSES	EVAPORATOR	
	IN	OUT
3	F	N
	N	F

LD07990

EVAP. SHELL CODE	NOZZLE PIPE SIZE			EVAPORATOR NOZZLE DIMENSIONS						
	NO. OF PASSES			1-PASS		2-PASS			3-PASS	
	1	2	3	AA ²	FF	BB ²	EE	FF	BB ²	FF
HF	16"	12"	10"	2'-0-3/4"	2'-2-1/4"	2'-0-3/4"	11"	2'-2-1/4"	2'-0-3/4"	2'-2-1/4"
HH	16"	12"	10"	2'-1-1/2"	2'-2-1/4"	2'-1-1/2"	11"	2'-2-1/4"	2'-1-1/2"	2'-2-1/4"
J	18"	14"	12"	2'-1-3/4"	2'-5-1/2"	2'-1-3/4"	11"	2'-5-1/2"	2'-1-3/4"	2'-5-1/2"
T	18"	14"	12"	2'-1-3/4"	2'-5-1/2"	2'-1-3/4"	11"	2'-5-1/2"	2'-1-3/4"	2'-5-1/2"
V	20"	16"	12"	2'-5-1/4"	2'-5-1/2"	2'-5-1/4"	1'-1"	2'-5-1/2"	2'-5-1/4"	2'-5-1/2"
W	20"	18"	14"	2'-7-1/4"	2'-8"	2'-7-1/4"	1'-3"	2'-8"	2'-7-1/4"	2'-8"


NOTES:

- Standard water nozzles are furnished as welding stub-outs with Victaulic grooves, allowing the option of welding, flanges, or use of Victaulic couplings. Factory-installed, class 150 (ANSI B16.5, round slip-on, forged carbon steel with 1/16" raised face), water flanged nozzles are optional (add 1/2" to nozzle length). Companion flanges, nuts, bolts, and gaskets are not furnished.
- Add 1" if neoprene pads are supplied.
- One-, two- and three-pass nozzle arrangements are available only in pairs shown and for all shell codes. Any pair of evaporator nozzles may be used in combination with any pair of condenser nozzles.
- Connected piping should allow for removal of compact water boxes for tube access and cleaning.


Dimensions (Ft. - In.) – Nozzle Arrangements

EVAPORATORS – MARINE WATER BOXES – J COMPRESSOR UNITS

COMPR. CODE	EVAP-COND SHELL CODE	G	H
J1, J2	H-G	1'-2-3/4"	1'-11-3/4"
	H-H	1'-2-3/4"	1'-11-3/4"
J3, J4	J-J	1'-2-3/4"	1'-11-3/4"
	T-T	1'-2-3/4"	1'-11-3/4"
	V-V	1'-2-3/4"	1'-11-3/4"
	W-V	1'-4-1/2"	2'-0-3/4"

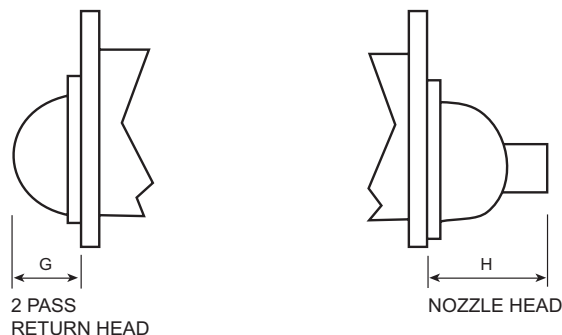


LD08639

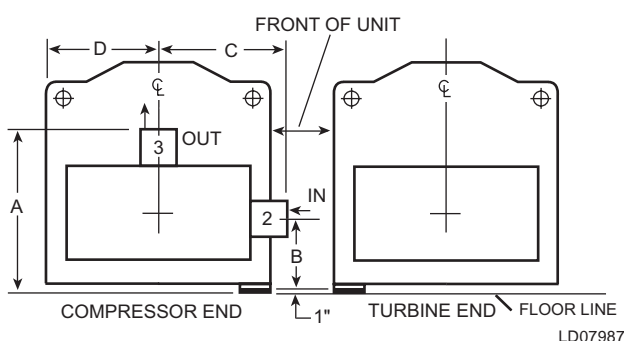

2-PASS

EVAP. SHELL CODE	EVAPORATOR NOZZLE DIMENSIONS			
	2-PASS			
	A ⁵	B ⁵	C	D
H F	4'-5-1/4"	2'-2-3/4"	2'-7-1/4"	2'-2-1/4"
H H	4'-6"	1'-8-1/4"	2'-7-1/4"	2'-2-1/4"
J	3'-11-3/4"	1'-9-3/4"	2'-10-1/4"	2'-5-1/2"
T	3'-11-3/4"	1'-9-3/4"	2'-10-1/4"	2'-5-1/2"
V	4'-3-1/4"	2'-1-1/2"	2'-10-1/4"	2'-5-1/2"
W	4'-6-1/2"	2'-3-1/2"	3'-2"	2'-6"

EVAPORATOR	
2-PASS	
IN	OUT
2	3

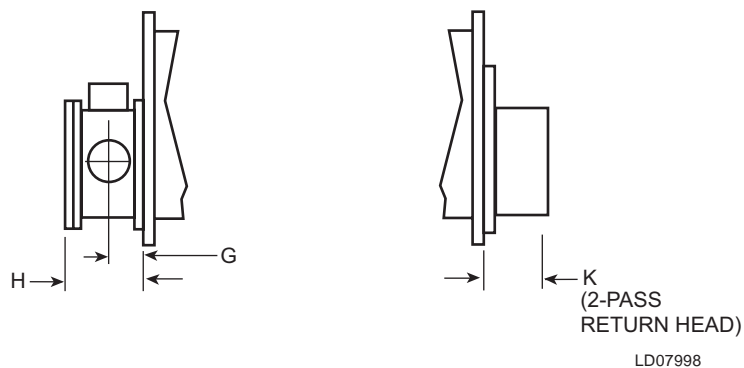


EVAPORATOR SHELL CODE	NOZZLE PIPE SIZE
	NO. OF PASSES
	2
H	12"
J	14"
T	14"
V	16"
W	18"

EVAPORATOR SHELL CODE	EVAPORATOR NOZZLE DIMENSIONS (2-PASS)		
	G	H	K
H	11-3/8"	2'-0-3/4"	1'-2-3/4"
J	1'-0-3/8"	2'-2-3/4"	1'-2-3/4"
T	1'-0-3/8"	2'-2-3/4"	1'-2-3/4"
V	1'-2"	2'-6"	1'-2-3/4"
W	1'-3"	2'-6"	1'-4-1/2"

NOTES:

- All dimensions are approximate. Certified dimensions are available upon request.
- Standard water nozzles are Schedule 40 pipe size, furnished as welding stub-outs with Victaulic grooves, allowing the option of welding, flanges, or use of Victaulic couplings. Factory-installed, class 150 (ANSI B16.5, round slip-on, forged carbon steel with 1/16" raised face), water flanged nozzles are optional (add 1/2" to nozzle length). Companion flanges, nuts, bolts, and gaskets are not furnished.
- Compact water boxes on one heat exchanger may be used with Marine Water Boxes on the other heat exchanger.
- Water must enter the water box through the bottom connection to achieve rated performance.
- Add 1" if neoprene pads are supplied.

CONDENSERS – MARINE WATER BOXES – J COMPRESSOR UNITS

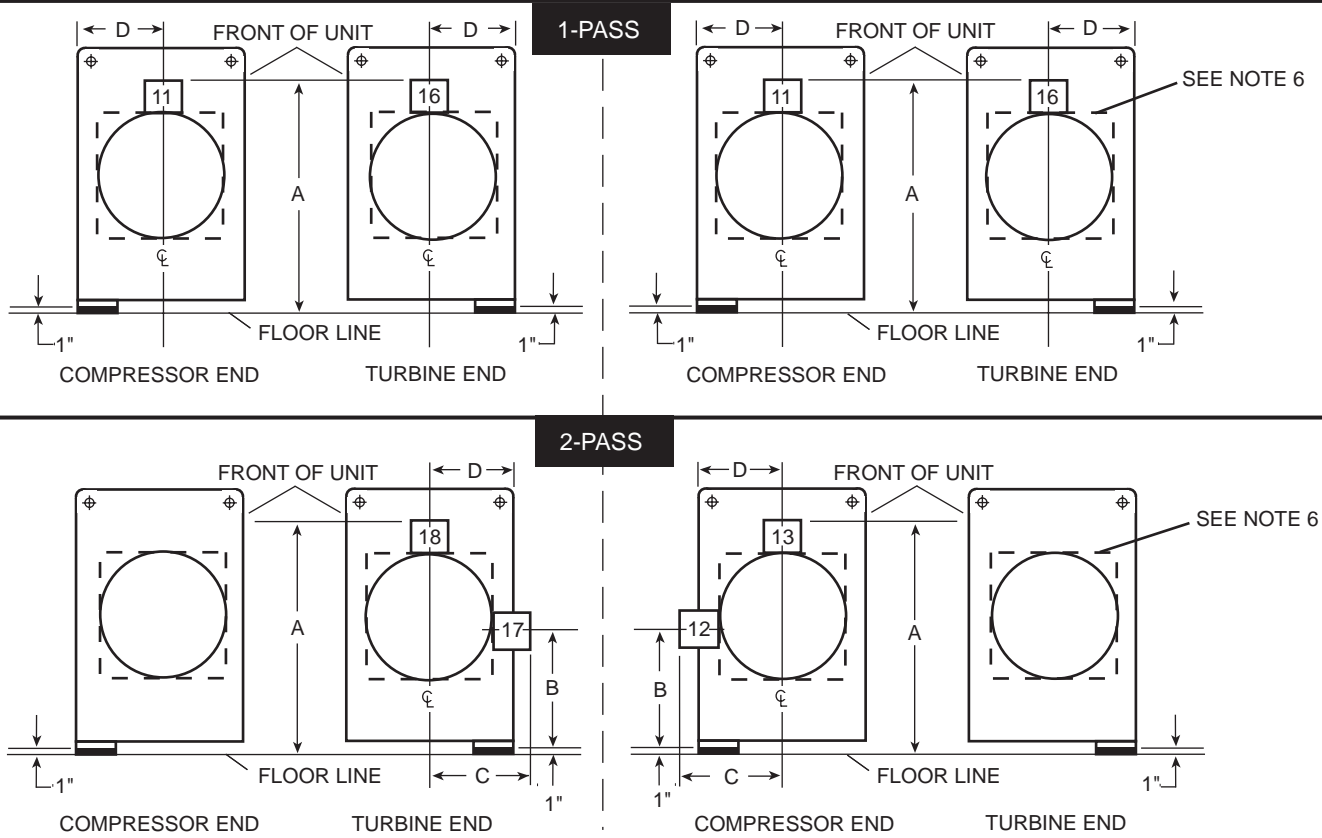



LD07991

COND. SHELL CODE	CONDENSER NOZZLE DIMENSIONS					
	1-PASS		2-PASS			
	A ⁵	D	A ⁵	B ⁵	C	D
G	5'-9-3/4"	1'-9"	5'-9-3/4"	2'-8-3/4"	2'-5"	1'-9"
H	5'-11"	1'-11"	5'-10-1/4"	2'-0-3/4"	2'-1"	1'-11"
J	6'-3-3/8"	2'-1"	6'-2-3/8"	2'-1-1/2"	2'-1-1/8"	2'-1"
T	6'-3-3/8"	2'-1"	6'-2-3/8"	2'-1-1/2"	2'-1-1/8"	2'-1"
V	6'-8-3/4"	2'-3-1/2"	6'-8-1/8"	2'-1-3/4"	2'-5-3/8"	2'-3-1/2"

See Notes on page 28.

Dimensions (Ft. - In.) – Nozzle Arrangements

CONDENSER	
1-PASS	
IN	OUT
11	16
16	11

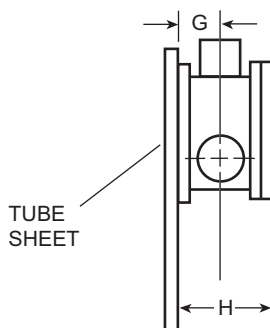(2-PASS
RETURN HEAD)

LD07183

CONDENSER	
2-PASS	
IN	OUT
12	13
17	18

CONDENSER SHELL CODE	COND. NOZZLE DIMENSIONS (1-PASS)	
	G	H
G	1'-1-1/4"	2'-4-3/8"
H	1'-3-1/2"	2'-8-3/4"
J	1'-3-1/2"	2'-8-7/8"
T	1'-3-1/2"	2'-8-7/8"
V	1'-3-1/2"	2'-9-3/8"



COND. SHELL CODE	NOZZLE PIPE SIZE NO. OF PASSES	
	1	2
G	16"	14"
H	20"	16"
J	20"	16"
T	20"	16"
V	20"	18"

CONDENSER SHELL CODE	COND. NOZZLE DIMENSIONS (2-PASS)		
	G	H	K
G	1'-0-1/4"	2'-2-3/8"	0'-5-7/8"
H	1'-1-5/8"	2'-5"	0'-11-5/8"
J	1'-1-5/8"	2'-5-1/8"	1'-0-1/2"
T	1'-1-5/8"	2'-5-1/8"	1'-0-1/2"
V	1'-2-1/4"	2'-6-3/4"	1'-1-5/8"

NOTES (see table on page 27):

- All dimensions are approximate. Certified dimensions are available upon request.
- Standard water nozzles are Schedule 40 pipe size, furnished as welding stub-outs with Victaulic grooves, allowing the option of welding, flanges, or use of Victaulic couplings. Factory-installed, class 150 (ANSI B16.5, round slip-on, forged carbon steel with 1/16" raised face), water flanged nozzles are optional (add 1/2" to nozzle length). Companion flanges, nuts, bolts, and gaskets are not furnished.
- One- and two-pass nozzle arrangements are available only in pairs shown and for all shell codes. Any pair of evaporator nozzles may be used in combination with any pair of condenser nozzles. Compact water boxes on one heat exchanger may be used with Marine Water Boxes on the other heat exchanger.
- Condenser water must enter the water box through the bottom connection for proper operation of the sub-cooler to achieve rated performance.
- Add 1" if neoprene pads are supplied.
- "G" Condenser Water Boxes are square; other codes are round as shown.

Steam Condenser (ft. - in.)

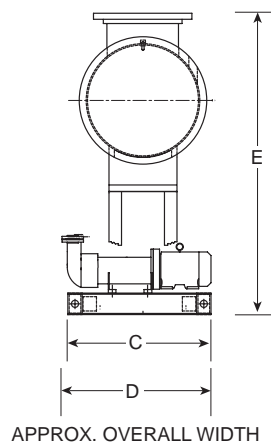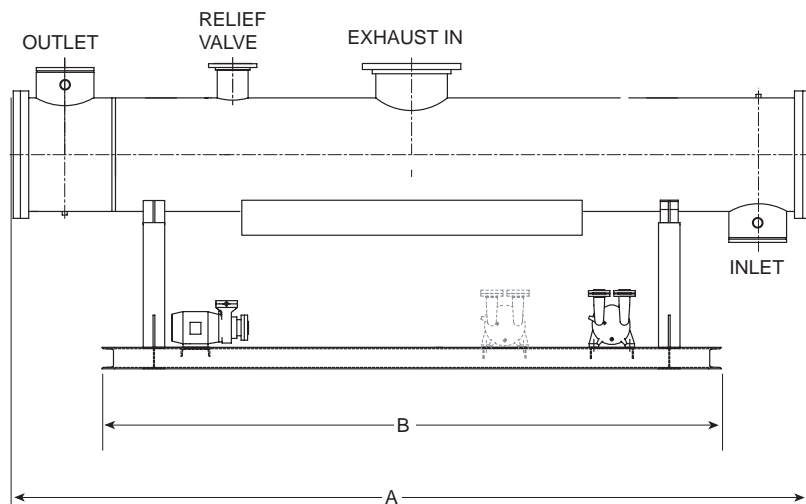

LD08001

STEAMCONDENSER MODEL

Dimension Code	29168 ft-inches	31168 ft-inches	35168 ft-inches	33192 ft-inches
B	14'-5"	14'-5"	14'-5"	16'-5"
C	3'-4"	3'-4"	3'-10"	3'-10"
D	4'-0"	4'-0"	4'-4"	4'-3"
E	6'-11-3/8"	7'-1-3/8"	7'-5-3/8"	7'-3-3/8"

DIMENSION "A" FOR ALL MODELS

Model	1 Pass Refrig. Cond.		2 Pass Refrig. Cond.	
	ft-inches		ft-inches	
29168	18'-5-7/8"		18'-2-5/8"	
31168 w/H-G shells	18'-6-5/8"		18'-3-3/8"	
31168 w/H-H shells	19'-3-3/8"		18'-7-5/8"	
35168	19'-4-3/8"		18'-8-5/8"	
33192 w/T-T shells	21'-3-7/8"		20'-8-1/8"	
33192 w/V-V shells	21'-3-7/8"		20'-11-1/4"	
33192 w/W-V shells	21'-3-7/8"		20'-11-1/4"	

Weights (Lbs.)

TABLE 3 – BASE UNIT WEIGHTS LESS STEAM TURBINE AND STEAM CONDENSER PACKAGES

COMPRESSOR	SHELLS	SHIPPING WEIGHT (LBS.)	OPERATING WEIGHT (LBS.)	EST. REFRIGERANT CHARGE (LBS.)	
H6/H7	G-G	GBGB	26,320	32,210	2415
		GBGD	26,950	33,140	
		GCGB	26,650	32,680	
		GCGD	27,290	33,610	
		GDGB	27,110	33,330	
		GDGD	27,740	34,250	
J1/J2	H-G	HFGD	28,020	34,080	2625
		HFGD	28,650	35,800	
		HHGB	28,550	35,630	
		HHGD	29,190	36,570	
J2	H-H	HFHB	29,430	36,760	2825
		HFHD	29,850	37,380	
		HHHB	29,970	37,530	
		HHHD	30,380	38,140	
J3	J-J	JFJB	35,310	44,100	3495
		JFJD	35,960	45,050	
		JGJB	35,880	44,620	
		JGJD	36,330	45,580	
		JHJB	36,040	45,140	
		JHJD	36,700	46,110	
J4	T-T	TFTB	38,260	48,230	3995
		TFTD	39,010	49,330	
		TGTB	38,680	48,630	
		TGTD	39,440	49,940	
		THTB	39,110	49,440	
		THTD	39,860	50,540	
J4	V-V	VFVB	42,700	54,670	4150
		VFVD	43,720	56,170	
		VHVB	43,290	55,520	
		VHVD	44,310	57,010	
J4	W-V	WFVB	46,180	59,850	4460
		WFVD	47,200	61,340	
		WHVB	47,550	61,790	
		WHVD	48,570	63,290	

* Refer to product drawings for detailed weight information.

TABLE 4 – 150 LB DWP EVAPORATOR MARINE WATER BOX WEIGHTS

SHELL CODE	COMPRESSOR CODE	SHIPPING WEIGHT INCREASE 2 PASS (LBS)	OPERATING WEIGHT INCREASE 2 PASS (LBS)
G	H6/H7	1,238	1,606
H	J1/J2	1,514	1,775
J/T	J3/J4	1,715	2,100
V	J4	1,820	2,490
W	J4	2,455	3,270

TABLE 5 – 150 LB DWP REFRIGERANT CONDENSER MARINE WATER BOX WEIGHTS**

SHELL CODE	COMPRESSOR CODE	SHIPPING INCREASE 1 PASS (LBS)	OPERATING INCREASE 1 PASS (LBS)	SHIPPING INCREASE 2 PASS (LBS)	OPERATING INCREASE 2 PASS (LBS)
G	H6/H7	1,382	1,576	965	1,159
G	J1/J2	2,380	2,500	1,140	1,250
H	J2	2,495	2,650	1,210	1,340
J/T	J3/J4	2,990	3,390	1,485	1,700
V	J4	3,930	4,440	1,900	2,300

STEAM CONDENSER PACKAGE WEIGHTS

STEAM COND MODEL	SHIPPING WEIGHT (LBS)	OPERATING WEIGHT (LBS)
29168A	12,615	18,259
29168B	12,873	18,517
29168C	13,135	18,779
29168D	13,397	19,041
31168B	14,265	20,691
31168C	14,594	21,020
31168D	14,924	21,350
35168B	16,655	25,099
35168C	17,051	25,495
35168D	17,452	25,896
33192B	16,293	24,200
33192C	16,687	24,594
33192D	17,115	25,062

STEAM TURBINE PACKAGE WEIGHTS

TURBINE BASE MODEL	SHIPPING WEIGHT (LBS)	OPERATING WEIGHT (LBS)
K2G5	8,175	8,175
K2G7/KG8	8,675	8,675
KD7	11,980	11,980

**STEAM TURBINE PACKAGE –
BREAKDOWN SHIPPING WEIGHTS**

TURBINE BASE MODEL	STEAM TURBINE (LBS)	DRIVELINE BASE (LBS)
K2G5	6,500	1,675
K2G7/KG8	7,000	1,675
KD7	10,000	1,980

STEAM CONDENSER DUAL PUMP OPTION WEIGHT ADDER: **592 LBS.**ADDITIONAL CONDENSATE PUMP ONLY: **112 LBS.**ADDITIONAL VACUUM PUMP ONLY: **480 LBS.**

NOTE: Steam Condenser package weight for model 31168 varies depending on 16" or 20" nozzle size.

MISCELLANEOUS PIPING WEIGHT (STEAM TRUNK AND WATER PIPING TO STEAM CONDENSER) - LBS




STEAM TRUNK SIZE	REFRIGERANT CONDENSER OUTLET / STEAM CONDENSER INLET NOZZLE SIZE							
	14"		16"		18"		20"	
	VICT. GROOVE	FLANGES	VICT. GROOVE	FLANGES	VICT. GROOVE	FLANGES	VICT. GROOVE	FLANGES
20" X 20"	1565	1750	1610	1810	N/A	N/A	N/A	N/A
24" X 20"	N/A	N/A	1750	1950	N/A	N/A	1800	2140
24" X 24"	N/A	N/A	2060	2260	2085	2350	2110	2450

NOTES

- Base unit weights include control center, oil charge and isolator pads.
Weights shown do NOT include:
Marine water box weights (see separate table for weight adders)**
Refrigerant (see separate refrigerant charge weight adders)
Steam turbine (see separate table for turbine package weights)
Steam condenser (see separate table for steam condenser package weights)
Thermal insulation - add 125 lbs
Shipping skids - add 400 lbs
 - Operating weights shown include the shipping weights plus water and refrigerant operating charge.
 - Steam condenser package weights include single pumps only. When the dual pump option is ordered, use the weight adder to determine total package weight.
 - Miscellaneous weight includes steam exhaust trunk piping, steam trunk expansion joint, water connection piping between refrigerant condenser outlet and steam condenser water inlet and weight for miscellaneous components.
- ** YST is supplied with marine water boxes on refrigerant condenser as standard, however, marine water box weight adder must still be used to determine total chiller weight.

Dimensions (mm) – Unit

H COMPRESSOR UNITS

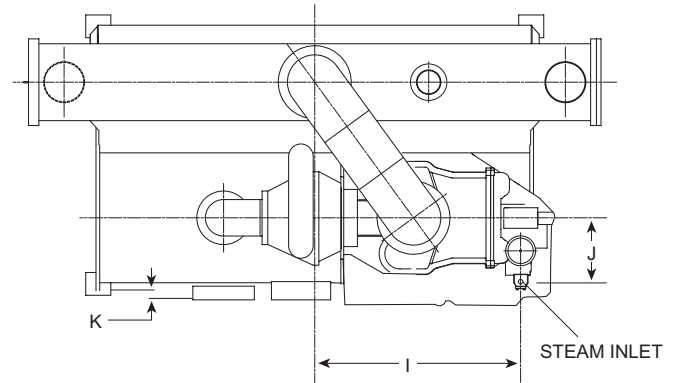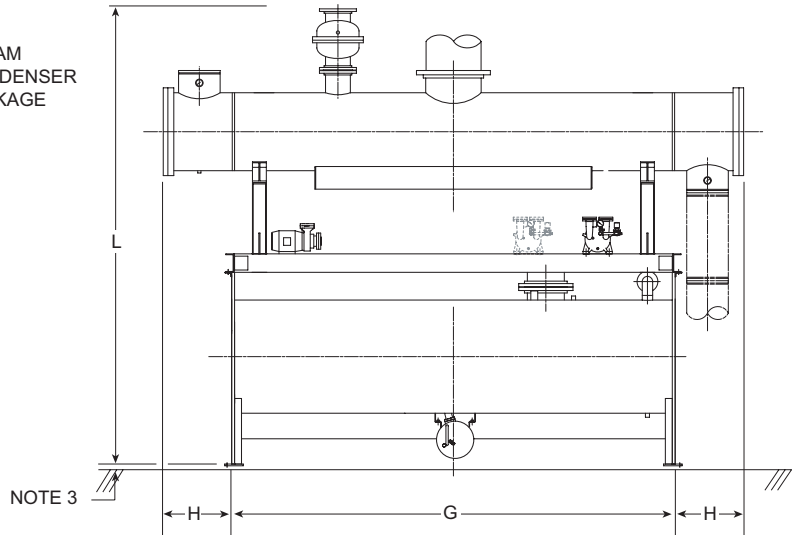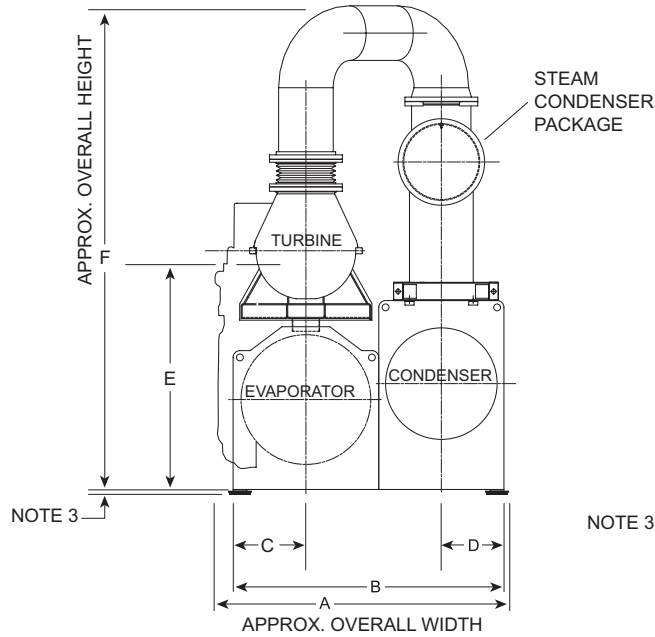

LD08000

H6/H7 COMPRESSOR (G-G SHELLS)	
KG Steam Turbine / 29168 Steam Condenser	
Dimension Code	mm
A	2655
B	2350
C	642
D	534
E w/4" strm inlet	2150
E w/6" strm inlet	2118
F	4801
G	4268
I	1980
J w/4" strm inlet	539
J w/6" strm inlet	666
K	45
L	4445

DIMENSION "H" FOR H6/H7 COMPRESSOR MODELS		
Steam Condenser Model 29168		
	1 Pass Refrig. Cond.	2 Pass Refrig. Cond.
Shell Code	mm	mm
GG	685	643


NOTES

1. All dimensions are approximate. Certified dimensions are available on request.
2. Water nozzles can be located on either end of unit. Add 13 mm to nozzle length for flanged connections.
3. Add 44mm for neoprene pads or 19mm if neoprene pads are not supplied.

Dimensions (mm) – Nozzle Arrangements


EVAPORATORS – COMPACT WATER BOXES – H COMPRESSOR UNITS

1-PASS

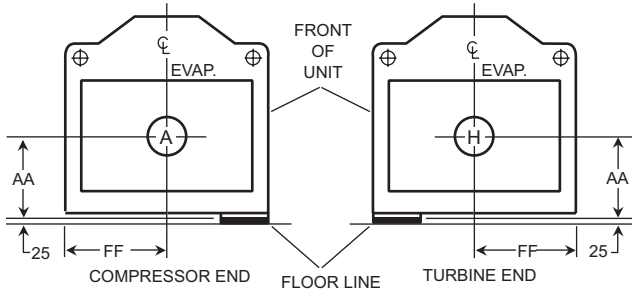

NOZZLE ARRANGEMENTS		
NO. OF PASSES	EVAPORATOR	
	IN	OUT
1	A	H
	H	A


2-PASS

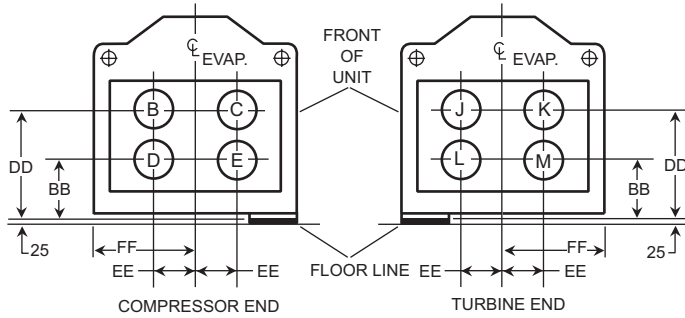

NOZZLE ARRANGEMENTS		
NO. OF PASSES	EVAPORATOR	
	IN	OUT
2	D	C
	E	B
	L	K
	M	J

SHELL CODE
G


3-PASS

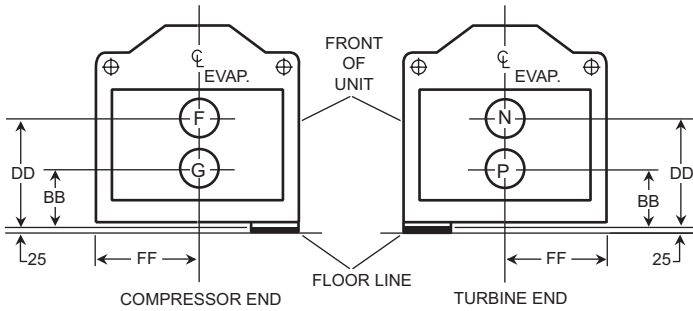

NOZZLE ARRANGEMENTS		
NO. OF PASSES	EVAPORATOR	
	IN	OUT
3	G	N
	P	F

LD07968A

EVAP. SHELL CODE	NOZZLE PIPE SIZES (in.)			EVAPORATOR NOZZLE DIMENSIONS (mm)								
	NO. OF PASSES			1-PASS		2-PASS				3-PASS		
	1	2	3	AA ⁵	FF	BB ⁵	DD ⁵	EE	FF	BB ⁵	DD ⁵	FF
G	16"	12"	10"	549	641	397	702	273	641	321	778	641

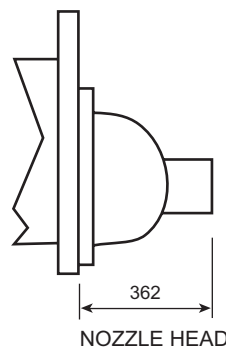


LD08639

Dimensions (mm) – Nozzle Arrangements


EVAPORATORS – MARINE WATER BOXES – H COMPRESSOR UNITS

2-PASS

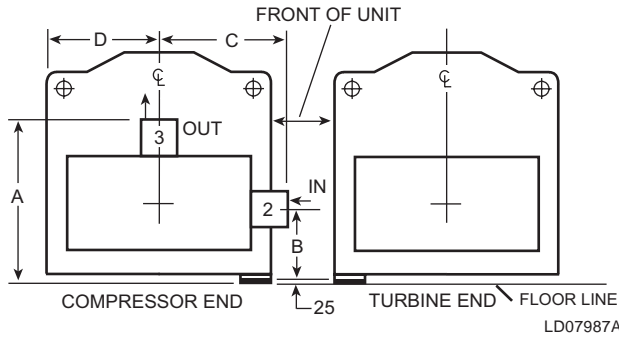

EVAP. SHELL CODE	EVAPORATOR NOZZLE DIMENSIONS (mm)			
	2-PASS			
	A ⁵	B ⁵	C	D
G	1,172	425	787	641

EVAPORATOR	
2-PASS	
IN	OUT
2	3

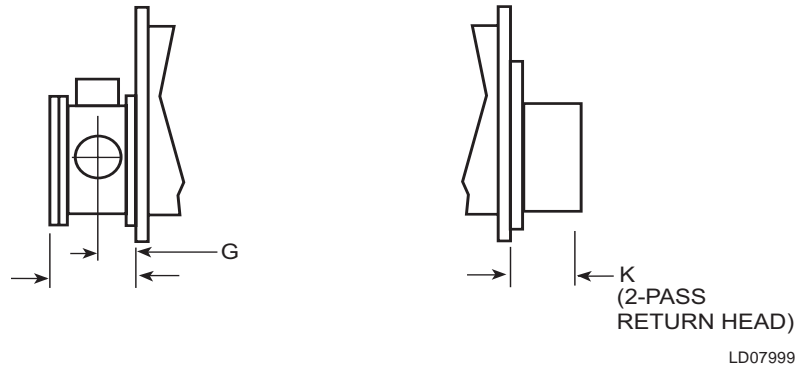


EVAPORATOR SHELL CODE	NOZZLE PIPE SIZE
	NO. OF PASSES
G	2
	12"

EVAPORATOR SHELL CODE	EVAPORATOR NOZZLE DIMENSIONS (2-PASS)		
	G	H	K
G	286	619	159

NOTES:

1. All dimensions are approximate. Certified dimensions are available upon request.
2. Standard water nozzles are Schedule 40 pipe size, furnished as welding stub-outs with Victaulic grooves, allowing the option of welding, flanges, or use of Victaulic couplings. Factory-installed, class 150 (ANSI B16.5, round slip-on, forged carbon steel with 1.6 mm raised face), water flanged nozzles are optional (add 13mm to nozzle length). Companion flanges, nuts, bolts, and gaskets are not furnished.
3. Any pair of evaporator nozzles may be used in combination with any pair of condenser nozzles. Compact water boxes on one heat exchanger may be used with Marine Water Boxes on the other heat exchanger.
4. Water must enter the water box through the bottom connection to achieve rated performance.
5. Add 25 mm if neoprene pads are supplied.

CONDENSERS – MARINE WATER BOXES – H COMPRESSOR UNITS

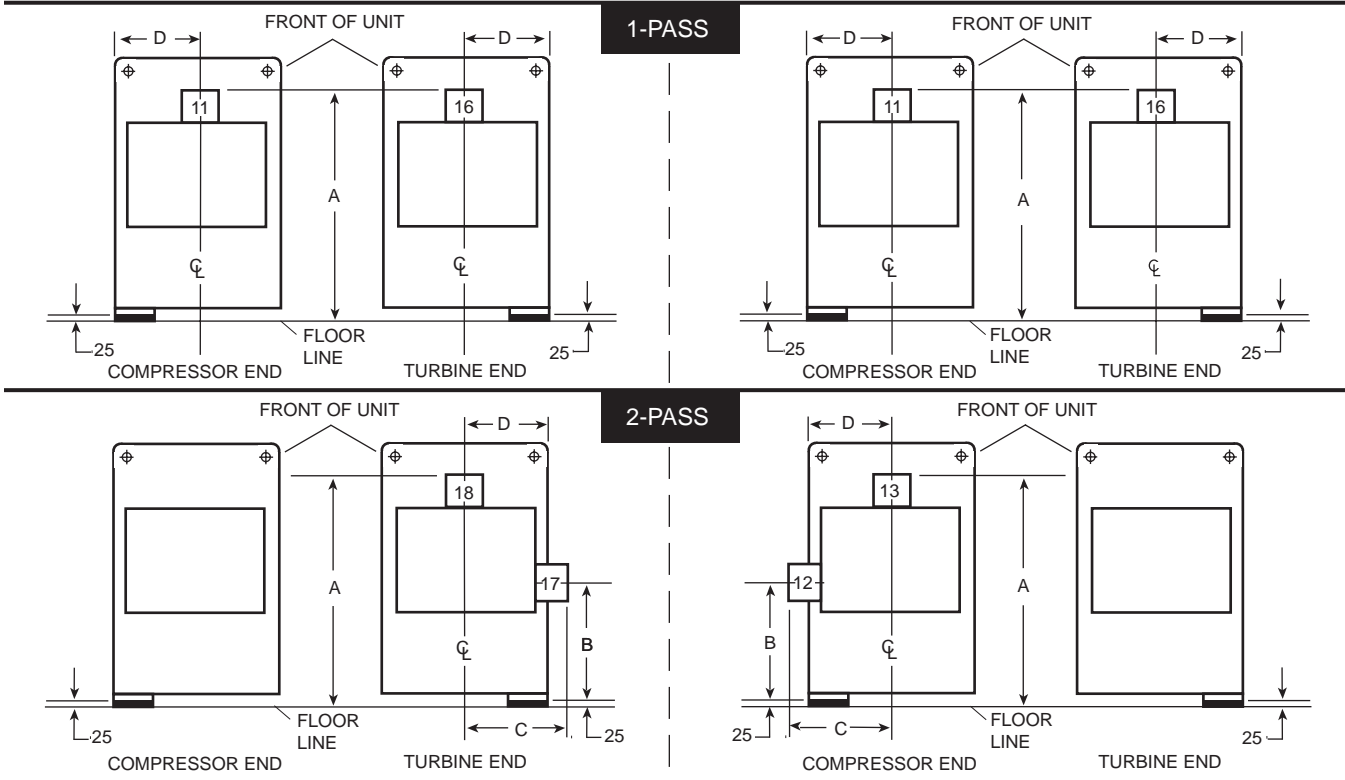


LD07988A

COND. SHELL CODE	CONDENSER NOZZLE DIMENSIONS (mm)					
	1-PASS		2-PASS			
	A ⁵	D	A ⁵	B ⁵	C	D
G	1,774	533	1,651	832	713	533

See Notes on page 35.

Dimensions (mm) – Nozzle Arrangements

CONDENSER	
1-PASS	
IN	OUT
11	16
16	11

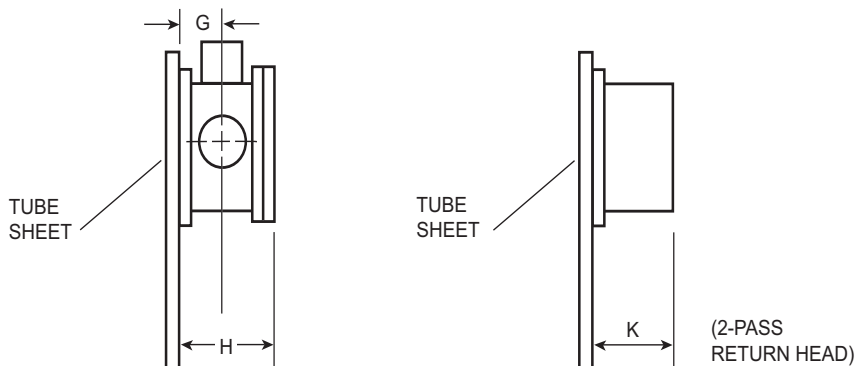

LD07177

CONDENSER	
2-PASS	
IN	OUT
12	13
17	18

CONDENSER SHELL CODE	COND. NOZZLE DIMENSIONS-mm (1-PASS)	
	G	H
G	337	721

COND. SHELL CODE	NOZZLE PIPE SIZE NO. OF PASSES	
	1	2
G	16"	14"




CONDENSER SHELL CODE	COND. NOZZLE DIMENSIONS - mm (2-PASS)		
	G	H	K
G	311	670	152

NOTES (see Table on page 34):

1. All dimensions are approximate. Certified dimensions are available upon request.
2. Standard water nozzles are Schedule 40 pipe size, furnished as welding stub-outs with Victaulic grooves, allowing the option of welding, flanges, or use of Victaulic couplings. Factory-installed, class 150 (ANSI B16.5, round slip-on, forged carbon steel with 1.6 mm raised face), water flanged nozzles are optional (add 13 mm to nozzle length). Companion flanges, nuts, bolts, and gaskets are not furnished.
3. One- and two-pass nozzle arrangements are available only in pairs shown and for all shell codes. Any pair of evaporator nozzles may be used in combination with any pair of condenser nozzles. Compact water boxes on one heat exchanger may be used with Marine Water Boxes on the other heat exchanger.
4. Condenser water must enter the water box through the bottom connection for proper operation of the sub-cooler to achieve rated performance.
5. Add 25 mm if neoprene pads are supplied.

Dimensions (mm) – Unit

J COMPRESSOR UNITS

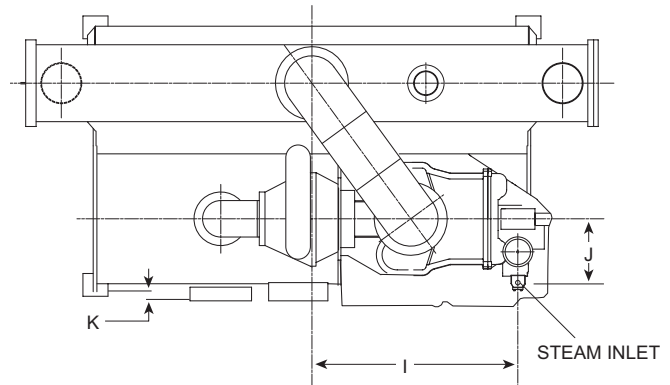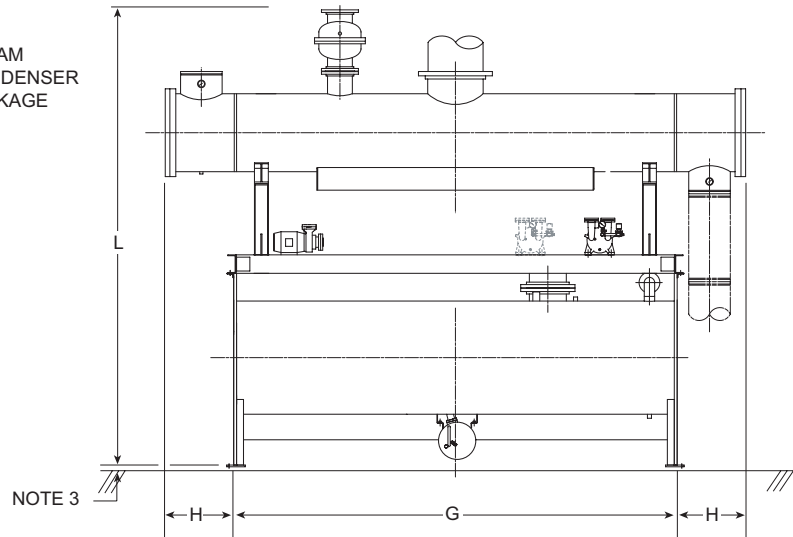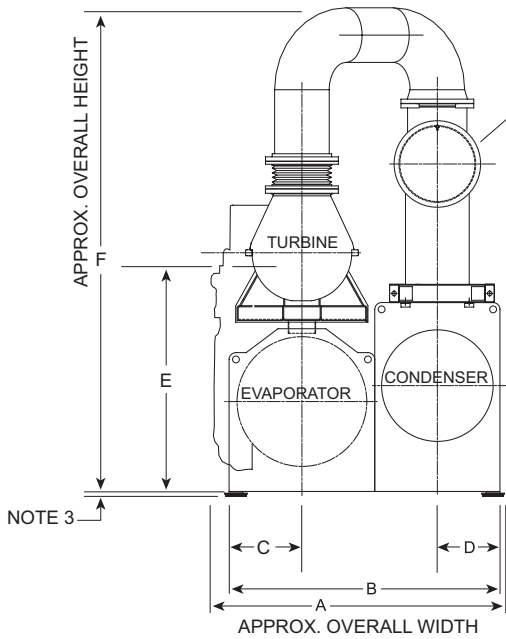

LD08000

J1 COMPRESSOR (H-G SHELLS)	
KG Steam Turbine/29168 Steam Condenser	
Dimension Code	mm
A	2725
B	2401
C	667
D	534
E w/4" stm inlet	2128
E w/6" stm inlet	2096
F	4801
G	4268
I	2039
J w/4" stm inlet	539
J w/6" stm inlet	666
K	96
L	4445

J2 COMPRESSOR		
KG Steam Turbine/31168 Steam Condenser		
Shell Code	HG	HH
Dimension Code	mm	mm
A	2725	2794
B	2401	2502
C	667	667
D	534	585
E w/4" stm inlet	2128	2204
E w/6" stm inlet	2096	2172
F	4852	4953
G	4268	4268
I	2039	2042
J w/4" stm inlet	539	539
J w/6" stm inlet	666	666
K	96	96
L	4495	4596

NOTES:

1. All dimensions are approximate. Certified dimensions are available on request.
2. Water nozzles can be located on either end of unit. Add 13mm to nozzle length for flanges connections.
3. Add 44mm for neoprene pads or 19mm if neoprene pads are not supplied.

Dimensions (mm) – Unit

J3 COMPRESSOR (J-J Shells)		
35168 Steam Condenser		
	KG Steam Turbine	KD Steam Turbine
Dimension Code	mm	mm
A	3048	3099
B	2769	2769
C	750	750
D	635	635
E w/4" strm inlet	2356	2325
E w/6" strm inlet	2325	2325
F	5360	5360
G	4268	4268
I	2020	TBD
J w/4" strm inlet	539	743
J w/6" strm inlet	666	748
K	115	115
L	4826	4826


J4 COMPRESSOR			
KD Steam Turbine/33192 Steam Condenser			
Shell Code	TT	VV	WV
Dimension Code	mm	mm	mm
A	3099	3175	3277
B	2769	2896	3023
C	750	750	813
D	635	699	699
E w/4" strm inlet	2375	2426	2490
E w/6" strm inlet	2375	2426	2490
F	5284	5411	5411
G	4877	4877	4877
I	TBD	TBD	TBD
J w/4" strm inlet	743	743	743
J w/6" strm inlet	748	748	748
K	115	115	102
L	4880	5007	5007

DIMENSION "H" FOR ALL J COMPRESSOR MODELS		
Steam Condenser Model 29168		
Shell Code	1 Pass Refrig. Cond.	2 Pass Refrig. Cond.
	mm	mm
HG	685	643
Steam Condenser Model 31168		
Shell Code	1 Pass Refrig. Cond.	2 Pass Refrig. Cond.
	mm	mm
HG	694	653
HH	805	707
Steam Condenser Model 35168		
Shell Code	1 Pass Refrig. Cond.	2 Pass Refrig. Cond.
	mm	mm
JJ	818	720
Steam Condenser Model 33192		
Shell Code	1 Pass Refrig. Cond.	2 Pass Refrig. Cond.
	mm	mm
TT	812	713
VV	812	753
WV	812	753

Dimensions (mm) – Nozzle Arrangements


EVAPORATORS – COMPACT WATER BOXES – J COMPRESSOR UNITS

1-PASS

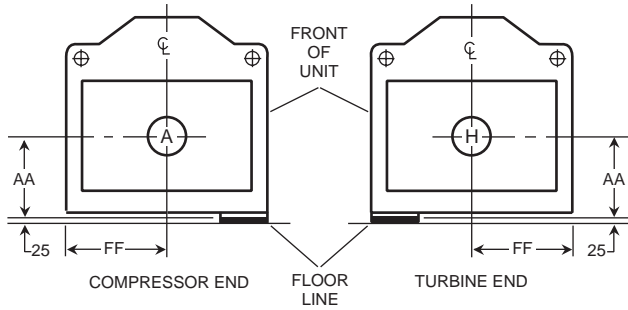


NOZZLE ARRANGEMENTS		
NO. OF PASSES	EVAPORATOR	
	IN	OUT
1	A	H
	H	A

2-PASS

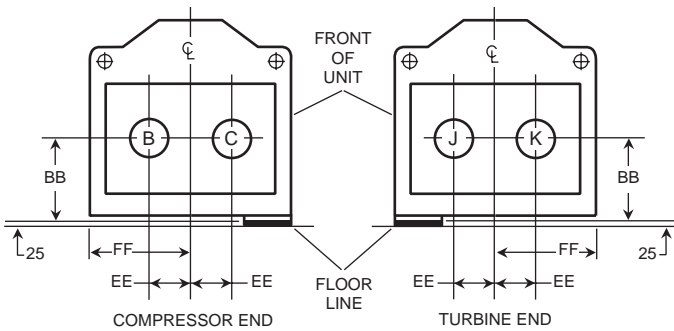

NOZZLE ARRANGEMENTS		
NO. OF PASSES	EVAPORATOR	
	IN	OUT
2	B	C
	C	B
	J	K
	K	J

3-PASS

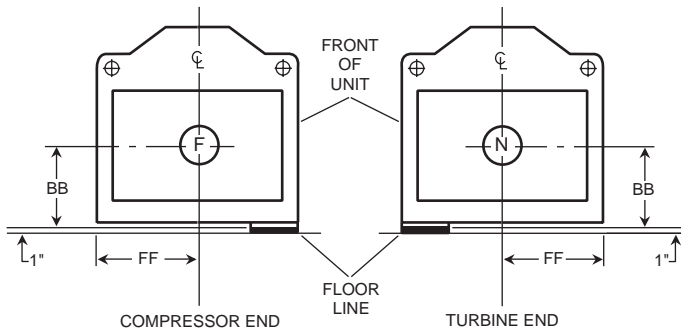

NOZZLE ARRANGEMENTS		
NO. OF PASSES	EVAPORATOR	
	IN	OUT
3	F	N
	N	F

LD07990A


EVAP. SHELL CODE	NOZZLE PIPE SIZE			EVAPORATOR NOZZLE DIMENSIONS (mm)						
	NO. OF PASSES			1-PASS		2-PASS			3-PASS	
	1	2	3	AA ²	FF	BB ²	EE	FF	BB ²	FF
H F	16"	12"	10"	629	667	629	279	667	629	667
H H	16"	12"	10"	648	667	648	279	667	648	667
J	18"	14"	12"	654	749	654	279	749	654	749
T	18"	14"	12"	654	749	654	279	749	654	749
V	20"	16"	12"	743	749	743	330	749	743	749
W	20"	18"	14"	794	813	794	381	813	794	813

NOTES:


- Standard water nozzles are furnished as welding stub-outs with Victaulic grooves, allowing the option of welding, flanges, or use of Victaulic couplings. Factory-installed, class 150 (ANSI B16.5, round slip-on, forged carbon steel with 1.6 mm raised face), water flanged nozzles are optional (add 13 mm to nozzle length). Companion flanges, nuts, bolts, and gaskets are not furnished.
- Add 25 mm if neoprene pads are supplied.
- One-, two- and three-pass nozzle arrangements are available only in pairs shown and for all shell codes. Any pair of evaporator nozzles may be used in combination with any pair of condenser nozzles.
- Connected piping should allow for removal of compact water boxes for tube access and cleaning.

EVAPORATORS – MARINE WATER BOXES – J COMPRESSOR UNITS

COMPR. CODE	EVAP-COND SHELL CODE	G H	
		G	H
J1, J2	H-G	375	603
	H-H	375	603
J3, J4	J-J	375	603
	T-T	375	603
	V-V	375	603
	W-V	419	629

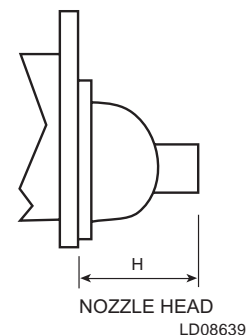


2-PASS

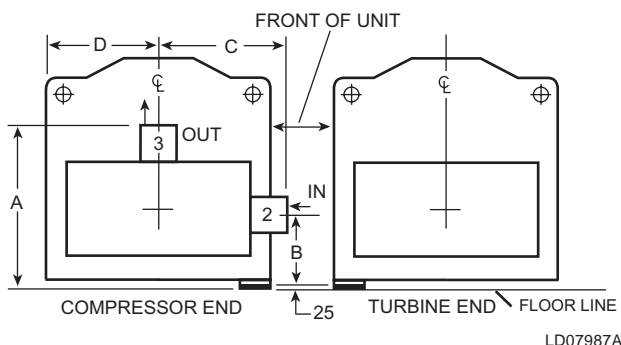

EVAP. SHELL CODE	EVAPORATOR NOZZLE DIMENSIONS (mm)			
	2-PASS			
	A ⁵	B ⁵	C	D
H F	1,353	679	794	667
H H	1,372	514	794	667
J	1,213	552	870	749
T	1,213	552	870	749
V	1,302	648	870	749
W	1,384	698	965	762

EVAPORATOR	
2-PASS	
IN	OUT
2	3

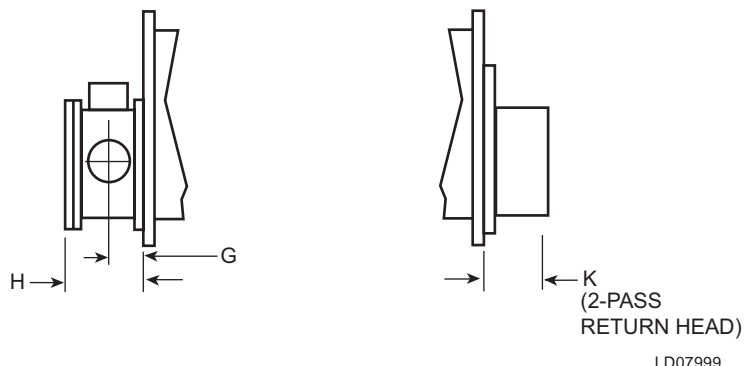


EVAPORATOR SHELL CODE	NOZZLE PIPE SIZE
	NO. OF PASSES
	2
H	12"
J	14"
T	14"
V	16"
W	18"

EVAPORATOR SHELL CODE	EVAPORATOR NOZZLE DIMENSIONS (2-PASS)		
	G	H	K
H	289	629	375
J	314	679	375
T	314	679	375
V	356	762	375
W	381	762	419

NOTES:

- All dimensions are approximate. Certified dimensions are available upon request.
- Standard water nozzles are Schedule 40 pipe size, furnished as welding stub-outs with Victaulic grooves, allowing the option of welding, flanges, or use of Victaulic couplings. Factory-installed, class 150 (ANSI B16.5, round slip-on, forged carbon steel with 1.6 mm raised face), water flanged nozzles are optional (add 13 mm to nozzle length). Companion flanges, nuts, bolts, and gaskets are not furnished.
- Any pair of evaporator nozzles may be used in combination with any pair of condenser nozzles. Compact water boxes on one heat exchanger may be used with Marine Water Boxes on the other heat exchanger.
- Water must enter the water box through the bottom connection to achieve rated performance.
- Add 25 mm if neoprene pads are supplied.

CONDENSER	
1-PASS	
IN	OUT
11	16
16	11

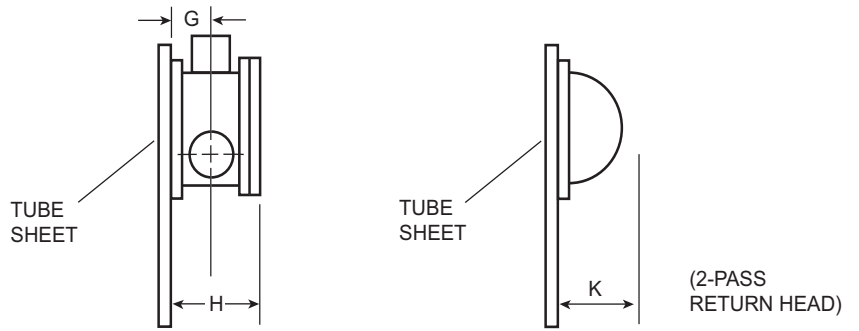

LD07183

CONDENSER	
2-PASS	
IN	OUT
12	13
17	18

CONDENSER SHELL CODE	COND. NOZZLE DIMENSIONS (1-PASS)	
	G	H
G	337	721
H	394	832
J	394	835
T	394	835
V	394	848



COND. SHELL CODE	NOZZLE PIPE SIZE NO. OF PASSES	
	1	2
G	16"	14"
H	20"	16"
J	20"	16"
T	20"	16"
V	20"	18"

CONDENSER SHELL CODE	COND. NOZZLE DIMENSIONS (2-PASS)		
	G	H	K
G	311	670	149
H	346	737	295
J	346	740	318
T	346	740	318
V	362	781	346

NOTES (see Table on page 39):

1. All dimensions are approximate. Certified dimensions are available upon request.
2. Standard water nozzles are Schedule 40 pipe size, furnished as welding stub-outs with Victaulic grooves, allowing the option of welding, flanges, or use of Victaulic couplings. Factory-installed, class 150 (ANSI B16.5, round slip-on, forged carbon steel with 1.6 mm raised face), water flanged nozzles are optional (add 13 mm to nozzle length). Companion flanges, nuts, bolts, and gaskets are not furnished.
3. One- and two-pass nozzle arrangements are available only in pairs shown and for all shell codes. Any pair of evaporator nozzles may be used in combination with any pair of condenser nozzles. Compact water boxes on one heat exchanger may be used with Marine Water Boxes on the other heat exchanger.
4. Condenser water must enter the water box through the bottom connection for proper operation of the sub-cooler to achieve rated performance.
5. Add 25 mm if neoprene pads are supplied.

Steam Condenser (Kg)

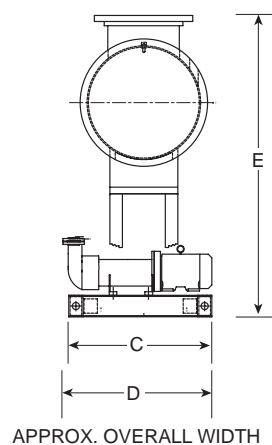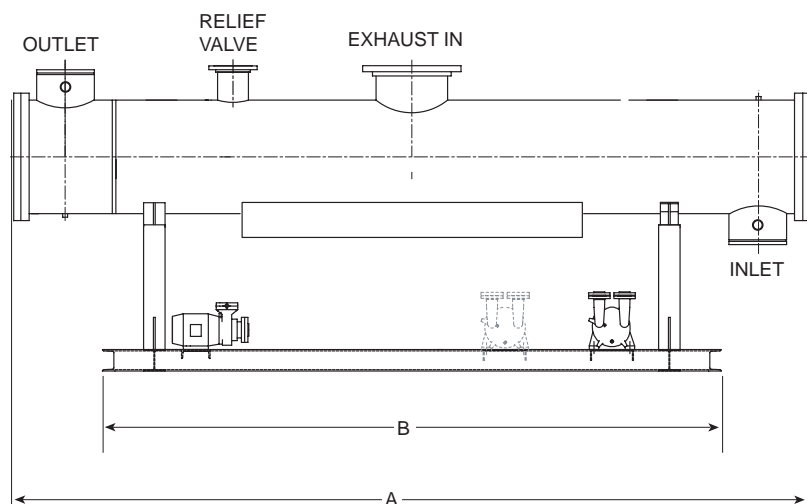

LD08001

Dimension Code	STEAMCONDENSER MODEL			
	29168	31168	35168	33192
	mm	mm	mm	mm
B	4395	4395	4395	5004
C	1016	1016	1169	1169
D	1220	1220	1321	1296
E	2118	2169	2271	2220

DIMENSION "A" FOR ALL MODELS		
Model	1 Pass Refrig. Cond.	2 Pass Refrig. Cond.
	mm	mm
29168	5636	5554
31168 w/H-G shells	5655	5573
31168 w/H-H shells	5877	5681
35168	5903	5706
33192 w/T-T shells	6500	6303
33192 w/V-V shells	6500	6382
33192 w/W-V shells	6500	6382

Weights (Kg)

TABLE 6 – BASE UNIT WEIGHTS LESS STEAM TURBINE AND STEAM CONDENSER PACKAGES

COMPRESSOR	SHELLS	SHIPPING WEIGHT (KG)	OPERATING WEIGHT (KG)	EST. REFRIGERANT CHARGE (KG)	
H6/H7	G-G	GBGB	11,939	14,610	1097
		GBGD	12,225	15,032	
		GCGB	12,088	14,824	
		GCGD	12,379	15,245	
		GDGB	12,297	15,118	
		GDGD	12,583	15,536	
J1/J2	H-G	HFGB	12,710	15,459	1193
		HFGD	12,996	16,239	
		HHGB	12,950	16,162	
		HHGD	13,241	16,588	
J2	H-H	HFHB	13,349	16,674	1284
		HFHD	13,540	16,956	
		HHHB	13,594	17,024	
		HHHD	13,780	17,300	
J3	J-J	JFJB	16,017	20,004	1588
		JFJD	16,312	20,435	
		JGJB	16,276	20,240	
		JGJD	16,480	20,675	
		JHJB	16,348	20,476	
		JHJD	16,648	20,916	
J4	T-T	TFTB	17,355	21,878	1815
		TFTD	17,695	22,376	
		TGTB	17,546	22,059	
		TGTD	17,890	22,653	
		THTB	17,741	22,426	
		THTD	18,081	22,925	
J4	V-V	VFVB	19,369	24,798	1886
		VFVD	19,831	25,479	
		VHVB	19,636	25,184	
		VHVD	20,099	25,860	
		WFVB	20,947	27,148	
J4	W-V	WFVD	21,410	27,824	2027
		WHVB	21,569	28,028	
		WHVD	22,031	28,708	

* Refer to product drawings for detailed weight information.

TABLE 7 – 150 LB DWP EVAPORATOR MARINE WATER BOX WEIGHTS

SHELL CODE	COMPRESSOR CODE	SHIPPING WEIGHT INCREASE 2 PASS (KG)	OPERATING WEIGHT INCREASE 2 PASS (KG)
G	H6/H7	562	728
H	J1/J2	687	805
J/T	J3/J4	778	953
V	J4	826	1,129
W	J4	1,114	1,483

Weights (Kg)

TABLE 8 – 150 LB DWP REFRIGERANT CONDENSER MARINE WATER BOX WEIGHTS**

SHELL CODE	COMPRESSOR CODE	SHIPPING INCREASE 1 PASS (KG)	OPERATING INCREASE 1 PASS (KG)	SHIPPING INCREASE 2 PASS (KG)	OPERATING INCREASE 2 PASS (KG)
G	H6/H7	627	715	438	526
G	J1/J2	1,080	1,134	517	567
H	J2	1,132	1,202	549	608
J/T	J3/J4	1,356	1,538	674	771
V	J4	1,783	2,014	862	1,043

STEAM CONDENSER PACKAGE WEIGHTS

STEAM COND MODEL	SHIPPING WEIGHT (KG)	OPERATING WEIGHT (KG)
29168A	5,722	8,282
29168B	5,839	8,399
29168C	5,958	8,518
29168D	6,077	8,637
31168B	6,471	9,385
31168C	6,620	9,535
31168D	6,770	9,684
35168B	7,555	11,385
35168C	7,734	11,565
35168D	7,916	11,746
33192B	7,391	10,977
33192C	7,569	11,156
33192D	7,763	11,368

STEAM TURBINE PACKAGE WEIGHTS

TURBINE BASE MODEL	SHIPPING WEIGHT (KG)	OPERATING WEIGHT (KG)
K2G5	3,708	3,708
K2G7/KG8	3,935	3,935
KD7	5,434	5,434

**STEAM TURBINE PACKAGE –
BREAKDOWN SHIPPING WEIGHTS**

TURBINE BASE MODEL	STEAM TURBINE (KG)	DRIVELIVE BASE (KG)
K2G5	2,949	760
K2G7/KG8	3,175	760
KD7	4,536	898

 STEAM CONDENSER DUAL PUMP OPTION WEIGHT ADDER: **269 KG**

 ADDITIONAL CONDENSATE PUMP ONLY: **51 KG**

 ADDITIONAL VACUUM PUMP ONLY: **218 KG**

NOTE: Steam Condenser package weight for model 31168 varies depending on 16" or 20" nozzle size.

MISCELLANEOUS PIPING WEIGHT (STEAM TRUNK AND WATER PIPING TO STEAM CONDENSER) - KG

STEAM TRUNK SIZE	REFRIGERANT CONDENSER OUTLET / STEAM CONDENSER INLET NOZZLE SIZE							
	14"		16"		18"		20"	
	VICT. GROOVE	FLANGES	VICT. GROOVE	FLANGES	VICT. GROOVE	FLANGES	VICT. GROOVE	FLANGES
20" X 20"	710	794	730	821	N/A	N/A	N/A	N/A
24" X 20"	N/A	N/A	794	885	N/A	N/A	816	971
24" X 24"	N/A	N/A	934	1025	946	1066	957	1111

NOTES

- Base unit weights include control center, oil charge and isolator pads.
Weights shown do NOT include:
Marine water box weights (see separate table for weight adders)**
Refrigerant (see separate refrigerant charge weight adders)
Steam turbine (see separate table for turbine package weights)
Steam condenser (see separate table for steam condenser package weights)
Thermal insulation - add 57 kg
Shipping skids - add 182 kg
 - Operating weights shown include the shipping weights plus water and refrigerant operating charge.
 - Steam condenser package weights include single pumps only. When the dual pump option is ordered, use the weight adder to determine total package weight.
 - Miscellaneous weight includes steam exhaust trunk piping, steam trunk expansion joint, water connection piping between refrigerant condenser outlet and steam condenser water inlet and weight for miscellaneous components.
- ** YST is supplied with marine water boxes on refrigerant condenser as standard, however, marine water box weight adder must still be used to determine total chiller weight.

Guide Specifications

GENERAL

Furnish and install where indicated on the drawings ____ YORK YST MAXE Centrifugal Liquid Chilling Unit(s). Each unit shall produce a capacity ____ of tonR, cooling ____ GPM of ____ from ____ °F to ____ °F when supplied with ____ GPM of condenser water at ____ °F. Steam consumption shall not exceed ____ lbs/hr with an IPLV (APLV) of _____. The evaporator shall be selected for ____ hrft²/BTU fouling factor and a maximum liquid pressure drop of ____ ft. Water side shall be designed for ____ psig working pressure. The refrigerant condenser shall be selected for ____ hrft²/BTU fouling factor and the steam condenser shall have a cleanliness factor of _____. The maximum refrigerant and steam condenser pressure drip shall be ____ ft. Waterside shall be designed for ____ psig working pressure. Steam shall be supplied to the turbine at ____ psig and ____ °F.

(or)

Furnish and install where indicated on the drawings ____ YORK YST MAXE Centrifugal Liquid Chilling Unit(s). Each unit shall produce a capacity of ____ kW, cooling ____ l/s of ____ from ____ °C to ____ °C when supplied with ____ l/s of condenser water at ____ °C. Steam consumption shall not exceed ____ kg/hr with an IPLV (APLV) of _____. The evaporator shall be selected for ____ m²K/kW fouling factor and maximum liquid pressure drop of ____ kPa. Waterside shall be designed for ____ barg working pressure. The refrigerant condenser shall be selected for ____ m²K/kW fouling factor and the steam condenser shall have a cleanliness factor of _____. The maximum refrigerant and steam condenser pressure drop shall be ____ kPa. Waterside shall be designed for ____ barg working pressure. Steam shall be supplied to the turbine at ____ barg and ____ °C.

Each unit shall be factory-packaged including evaporator, refrigerant condenser, sub-cooler, compressor, steam turbine, lubrication system, Power Panel, Programmable Control Center and all inter-connecting unit piping and wiring. A steam condenser shall be shipped separately and will be suitable for mounting on the refrigerant condenser. When specified, the steam condenser may be placed on the floor adjacent to the chiller (Customer to confirm which arrangement before the order is placed). The chiller shall be painted prior to shipment.

The initial charge of oil and refrigerant shall be supplied, shipped in containers and cylinders for field installation or factory charged in the chiller.

POWER PANEL

All motor contactors and circuit protectors, the compressor oil pump variable speed drive and the control power transformer shall be contained in an enclosure installed adjacent to the OptiView control center. A main power disconnect switch shall be supplied which provides the termination points for the customer's single point power supply wiring.

PROGRAMMABLE CONTROL CENTER

The Programmable Control Center shall be factory-mounted, wired and tested microprocessor based control system for R134a centrifugal chillers. The panel shall be configured with a 10.4" diagonal color Liquid Crystal Display (LCD) surrounded by "soft" keys, which are redefined with one keystroke based on the screen displayed at that time.

The LCD display shall provide a graphical and animated display of the chiller, chiller sub-systems and system parameters, allowing the presentation of several operating parameters at once. A Status Bar shall be displayed at all times on all screens containing the System - Status Line and Details Line, the Control Source, Access Level, Time and Date.

During turbine slow roll, startup, operation and coast-down, the system status shall indicate vital information available at any time. Data shall be displayed in either English or SI units.

Security access shall be provided to prevent unauthorized changes of setpoints. There must be different levels of access including a servicing level which shall provide diagnostics and troubleshooting information for the chiller and panel. Password protection shall be provided for all access levels.

The control center power supply is provided from a fused 2KVA transformer located in the power panel.

The control center is also fused to provide individual over-current protected power for the remote mounted water pump motor starters (supplied by others) and the controls installed on the chiller. Numbered terminal strips for wiring such as Remote Start / Stop, Chilled Water Pump and Local or Remote Cycling devices shall be provided. The Panel must also provide field interlocks that indicate the chiller status. These contacts shall include a Remote Mode Ready-to-Start, a Controlled Shutdown, a Safety Shutdown and a chiller Run contact. System pressures shall be monitored with transmitters (4-20 mA) and transducers (0-5 VDC). System temperatures shall be

monitored using thermistors and RTD's.

Setpoints can be changeable from a remote location via 0-10VDC and 4-20mA, contact closures or through serial communications. Serial data interface to the Building Automation System (BAS) shall be through an optional Microgateway Card that can be mounted inside the Control Center.

The operating program shall be stored in non-volatile memory to eliminate chiller failure due to AC power failure/battery discharge. Programmed setpoints shall be retained in lithium battery-backed RTC memory for 11 years minimum.

Control system shall allow the chiller to operate at 36°F (2.2°C) leaving chilled water temperature without nuisance trips on low water temperature by monitoring the chiller water and evaporator refrigerant liquid temperatures to prevent freeze up.

Every programmable point shall have a pop-up screen with the allowable ranges, so that the chiller can not be programmed to operate outside of its design limits.

The capacity control logic shall provide stable operation at maximum efficiency at off design conditions by modulating the turbine speed, compressor pre-rotation vanes and hot gas by-pass valve.

When the power is applied to the chiller, the HOME screen shall be displayed. The HOME screen shall display a visual representation of the chiller and a collection of data detailing important operations and parameters. The primary values that need to be monitored and controlled shall be shown on this screen.

CAPACITY CONTROL

The chiller shall be designed to operate with capacities from 100% to 10% of design capacity.

HOT GAS BY-PASS

The chiller shall be equipped with an external, hot gas by-pass valve providing operational capability for part loads down to 10% of design. Hot gas by-pass valve shall have an electric actuator and shall be automatically controlled by the chiller micropanel to open only when stable chiller operation cannot be maintained through speed reduction and PRV closure alone.

COMPRESSOR

The compressor shall be a single-stage centrifugal type driven by a condensing steam turbine. The housing shall

be fully accessible with vertical circular joints, with the complete operating assembly removable from the compressor and scroll housing. Compressor castings shall be designed for a minimum 200 psig (1379 kPa) working pressure and hydrostatically pressure tested at a minimum of 300 psig (2070 kPa). The rotor assembly shall consist of a heat-treated alloy steel drive shaft and impeller shaft with a cast aluminum, fully shrouded impeller. The impeller shall be designed for balanced thrust, dynamically balanced and overspeed tested for smooth, vibration-free operation. Insert-type journal and thrust bearings shall be fabricated of aluminum alloy, precision bored and axially grooved.

Internal single helical gears with crowned teeth shall be designed so that more than one tooth is in contact at all times to provide even load distribution and quiet operation. Each gear shall be individually mounted in its own journal and thrust bearings to isolate it from impeller and turbine forces. Shaft seal shall be provided in double bellows, double-seal, cartridge type. Capacity control shall be achieved by use of pre-rotation vanes and speed control to provide fully modulating control from full load to minimum load for maximum energy efficiency. Control shall automatically compensate for adverse operating conditions, such as fouled tubes, and adjust to prior operation after correction of these conditions.

The unit shall be capable of continuous, reliable operation with low ECWT at all load conditions as outlined on the equipment schedule. An external, electric actuator shall automatically control pre-rotation vane position.

COMPRESSOR LUBRICATION SYSTEM

Lubrication oil shall be force-fed to all compressor bearings, gears, and rotating surfaces by an external variable speed oil pump. The oil pump shall vary oil flow to the compressor based on operating and stand-by conditions, ensuring adequate lubrication at all times. The oil pump shall operate prior to start-up, during compressor operation and during coastdown. Compressor shall have an internal, auxiliary reservoir at the top of the compressor housing to provide gravity fed lubrication during coastdown in the event of a power failure.

An oil reservoir, separate from the compressor, shall contain the submersible 2 HP oil pump and a 3000 watt oil heater, thermostatically controlled to remove refrigerant from the oil.

Oil shall be filtered by an externally mounted 1/2 micron replaceable cartridge oil filter equipped with service valves. Oil shall be cooled via a shell and tube, water

cooled oil cooler sized to use refrigerant entering condenser water. The oil side of the oil cooler shall be provided with service valves and an Amot three way temperature control valve. Oil piping shall be completely factory-installed. The water side of the oil cooler shall be provided with service valves, inlet strainer and solenoid valve for automatic start/stop of cooling water flow. Water piping shall be factory installed with connections brought to the edge of the chiller package and clearly tagged for installation. An automatic oil return system shall be provided to recover any oil that may have migrated to the evaporator.

STEAM TURBINE DRIVELINE

Steam Turbine Package

The steam turbine shall be of a high efficiency multistage design operating at a nominal 4500 rpm design maximum speed.

The turbine shall be packaged on a driveline base, completely factory piped. The driveline base shall have a mating flange on shaft end of the package that will bolt directly to the compressor D-flange face providing a rigid interface between turbine package and compressor. Complete turbine/compressor driveline shall be factory aligned prior to shipment. Turbine drive shaft shall be directly connected to the compressor shaft with a flexible disc coupling. Coupling shall have all metal construction with no wearing parts to assure long life, and no lubrication requirements to provide low maintenance.

The turbine casing shall be horizontally split designed to allow longitudinal thermal expansion without affecting alignment or efficiency of the turbine. The shaft and wheels shall be alloy steel with the wheels shrunk and keyed to the shaft. The turbine blades shall be of 403 grade stainless steel and the shaft shall be ground throughout with stainless steel sprayed in the carbon ring end gland contact area. Stainless steel nozzles shall be furnished throughout the turbine. Carbon ring end gland and diaphragm seals shall be furnished. Turbine end gland carbon ring seals (minimum five seals per end gland) shall be separated by partitions of stainless steel. The end gland seals are to be arranged for the admission of sealing steam. Pressure reducing valves shall be provided to regulate the steam pressure from steam inlet pressure to the 1-3 psig (7 - 21 kPa) needed for the gland seal.

A stainless steel, inlet steam strainer with adequate size and mesh to minimize the pressure drop shall be supplied. Strainer shall be removable without breaking the steam piping connections.

A fiberglass insulating blanket shall be provided on the steam chest and barrel of the turbine for operator protection.

The turbine speed control shall be achieved by a governor valve that is integrated with the chiller controls. The valve shall be of stainless steel with stainless steel seats and designed to control flow throughout the entire operating range of the turbine. The system shall employ an overspeed governor designed to close an independent high performance butterfly trip valve with a pneumatic actuator when the turbine speed exceeds 110 percent of the maximum continuous operating speed of the turbine. Activation of the independent trip valve shall cause the governor valve to also close. A micro switch shall be furnished on the trip linkage for the customer's use.

TURBINE LUBRICATION SYSTEMS

Ring Oil Lubricated Turbines - Drive powers less than 1700Hp (1268 kW) only

The bearings shall be steel backed, babbitt lined, split sleeve type. The design shall be such that the bottom half is removable with the shaft in place. The bearing housing shall have provisions for air purging of the housing shaft seals. The thrust bearing shall be an antifriction ball bearing, accessible and removable without lifting the top half of the turbine casing. Oil cooling with water cooled bearing housings shall be provided.

External, Pressurized Lube System Turbines

The bearings shall be steel backed, babbitt lined, split sleeve type. The design shall be such that the bottom half is removable with the shaft in place. The bearing housing shall have provisions for air purging of the housing shaft seals. The thrust bearing shall be a double acting, Kingsbury type. The lubrication system shall be integral to the turbine driveline base and completely factory piped. The lubrication system shall consist of a turbine shaft driven main oil pump, motor driven auxiliary oil pump, water cooled shell and tube oil cooler, 25 micron full flow oil filter and separate oil reservoir with level gauge. Oil temperature control shall be by Amot three way temperature control valve.

STEAM CONDENSER PACKAGE

A steam condenser shall be provided to condense exhaust steam at vacuum pressures to maintain efficient turbine operation. The steam condenser water circuit shall be piped in series with the refrigerant condenser, eliminating a separate cooling water circuit and shall be designed to minimize pressure drop for energy savings.

The steam condenser shall be furnished fully packaged. The package shall include a single 5 HP hotwell pump, a single 7.5 HP liquid ring vacuum pump for air removal, atmospheric relief valve and level control system. The package shall be factory piped, wired and mounted on a common structural steel frame suitable for installation on the refrigerant condenser or floor mounting adjacent to the chiller system.

Steam condenser construction shall be of the shell and tube type of welded steel construction with 3/4" OD (19 mm) prime surface copper tubes, roller-expanded into tube sheets. Water side shall be suitable for a maximum working pressure of 150 psig (1030 kPa). Steam side shall be designed for 15 psig (100 kPa) and 30" Hg vac (760 mmHg). Water boxes shall be welded steel with removable covers. Condensate level shall be controlled by a level control system with two (2) pneumatic control valves - one for re-circulation and the other for removal of condensate. The liquid ring vacuum pump shall be capable of drawing the condenser down to operating pressure in approximately 10 minutes. Hotwell pump shall be single-stage, end suction suitable for hotwell service.

Atmospheric relief valve shall be a water seal type with external handwheel, sized in accordance with the Heat Exchange Institute Standards (HEI) for protection of the steam turbine exhaust, steam trunk and steam condenser.

All key control and monitoring parameters shall be integral to the chiller control panel. In addition, auxiliary pressure gauges shall be located at the condenser steam inlet and condensate pump discharge piping, and temperature gauges shall be located at the steam inlet, cooling water inlet and outlet, and the hotwell.

To facilitate rigging, condenser shall be separable from the skid by unbolting. Insofar as practical, piping shall be outfitted with unions at reasonable break-points. Both condenser and skid shall be outfitted with lifting lugs for both vertical and horizontal lifting.

EVAPORATOR

Evaporator shall be of the shell-and-tube, flooded type designed for a minimum of 180 psig (1241 kPa); working pressure on the refrigerant side. Shell shall be fabricated from rolled carbon steel plates with fusion welded seams, carbon steel tube sheets, drilled and reamed to accommodate the tubes, and intermediate tube supports spaced no more than four feet apart. The refrigerant side of each shell is designed, tested and stamped in accordance with ASME Boiler and Pressure Vessel

Code, Section VIII - Division I, or other pressure vessel code as appropriate.

Heat exchanger tubes shall be high-efficiency, externally and internally enhanced type. Tubes shall utilize the "skip-fin" design, providing a smooth internal and external surface at each intermediate tube support. This provides extra wall thickness and non-work hardened copper at the support location, extending the life of the heat exchangers. If skip-fin tubes are not used, minimum tube wall thickness shall be 0.035" (0.889 mm). Each tube shall be roller expanded into the tube sheets providing a leak-proof seal, and be individually replaceable. Water velocity through the tubes shall not exceed 12 ft./sec. (3.7 m/s). A liquid level sight glass shall be provided on the side of the shell to aid in determining proper refrigerant charge and to check condition of the refrigerant charge. A suction baffle or aluminum mesh eliminators shall be located above the tube bundle to prevent liquid refrigerant carryover to the compressor. The evaporator shall have a refrigerant relief device sized to meet the requirements of the ASHRAE 15 Safety Code for Mechanical Refrigeration. Water boxes shall be removable to permit tube cleaning and replacement. Stub-out water connections having Victaulic grooves shall be provided.

Water boxes shall be designed for 150 psig (1030 kPa) design working pressure and be tested at 225 psig (1550 kPa). Vent and drain connections with plugs shall be provided on each water box.

(Option) The water boxes shall be suitable for 300 psig (2070 kPa) and be tested at 450 psig (3103 kPa). Vent and drain connections with plugs shall be provided on each water box.

REFRIGERANT CONDENSER

Refrigerant condenser shall be of the shell-and-tube type, designed for a minimum of 235 psig (1620 kPa) working pressure on the refrigerant side. Shell shall be fabricated from rolled carbon steel plates with fusion welded seams. Carbon steel tube sheets, drilled and reamed to accommodate the tubes, are welded to the end of each shell. Intermediate tube supports are drilled and reamed to eliminate sharp edges, fabricated from carbon steel plates. The refrigerant side of each shell is designed, tested and stamped in accordance with ASME Boiler and Pressure Vessel Code, Section VIII - Division I, or other pressure vessel code as appropriate.

Heat exchanger tubes shall be high efficiency, externally and internally enhanced type. Tubes shall utilize the

“skip-fin” design, providing a smooth internal and external surface at each intermediate tube support. This provides extra wall thickness and non-work hardened copper at the support location, extending the life of the heat exchangers. If skip-fin tubes are not used, minimum tube wall thickness shall be 0.035" (0.889 mm). Each tube shall be roller expanded into the tube sheets providing a leak-proof seal, and be individually replaceable. Water velocity through the tubes shall not exceed 12 ft/sec (3.7 m/s). A liquid level sight glass shall be provided on the side of the shell to aid in determining proper refrigerant charge and to check condition of the refrigerant charge. The refrigerant condenser shall have dual refrigerant relief devices; each sized to meet the requirements of the ASHRAE 15 Safety Code for Mechanical Refrigeration. Arrangement shall allow either valve to be isolated and replaced without removing the unit refrigerant charge.

(Option) The refrigerant condenser shall be provided with positive shutoff valves in the compressor discharge line and in the liquid line leaving the condenser. This will allow pump down and storage of the refrigerant charge in the refrigerant condenser.

Water boxes shall be removable to permit tube cleaning and replacement. Stubout water connections having Victaulic grooves shall be provided. Water boxes shall be designed for 150 psig (1030 kPa) design working pressure and be tested at 225 psig (1550 kPa). Vent

and drain connections with plugs shall be provided on each water box.

REFRIGERANT FLOW CONTROL

A variable orifice valve shall control refrigerant flow to the evaporator. This valve control shall automatically adjust to maintain proper refrigerant level in the refrigerant condenser and shall be controlled by monitoring refrigerant liquid level, assuring optimal subcooler performance.

PORTABLE REFRIGERANT STORAGE RECYCLING SYSTEM

A portable, self-contained refrigerant storage / recycling system shall be provided consisting of a refrigerant compressor with oil separator, storage receiver, water-cooled condenser, filter drier and necessary valves and hoses to remove, replace and distill refrigerant. All necessary controls and safety devices shall be a permanent part of the system.

START-UP AND OPERATOR TRAINING

The chiller manufacturer shall include the services of a factory-trained, field service representative to supervise the final leak testing, charging and the initial startup and concurrent operator instruction.

SI Metric Conversion

Values provided in this manual are in the English inch-pound (I-P) system.
The following factors can be used to convert from English to the most common SI Metric values.

MEASUREMENT	MULTIPLY THIS ENGLISH VALUE	BY	TO OBTAIN THIS METRIC VALUE
CAPACITY	TONS REFRIGERANT EFFECT (ton)	3.516	KILOWATTS (kW)
POWER	KILOWATTS (kW)	NO CHANGE	KILOWATTS (kW)
	HORSEPOWER (hp)	0.7457	KILOWATTS (kW)
FLOW RATE	GALLONS / MINUTE (gpm)	0.0631	LITERS / SECOND (L/s)
LENGTH	FEET (ft)	304.8	MILLIMETERS (mm)
	INCHES (in)	25.4	MILLIMETERS (mm)
WEIGHT	POUNDS (lb)	0.4536	KILOGRAMS (kg)
VELOCITY	FEET / SECOND (fps)	0.3048	METERS / SECOND (m/s)
PRESSURE DROP	FEET OF WATER (ft)	2.989	KILOPASCALS (k Pa)
	POUNDS / SQ. INCH (psi)	6.895	KILOPASCALS (k Pa)

TEMPERATURE

To convert degrees Fahrenheit (°F) to degrees Celsius (°C), subtract 32° and multiply by 5/9 or 0.5556.

To convert a temperature range (i.e., 10°F or 12°F chilled water range) from Fahrenheit to Celsius, multiply by 5/9 or 0.5556.

EFFICIENCY

In the English I-P system, chiller efficiency is measured in kW / ton:

$$\text{kW / ton} = \frac{\text{kW input}}{\text{tons refrigerant effect}}$$

In the SI Metric system, chiller efficiency is measured in Coefficient of Performance (COP).

$$\text{COP} = \frac{\text{kW refrigeration effect}}{\text{kW input}}$$

kW / ton and COP are related as follows:

$$\text{kW/ton} = \frac{3.516}{\text{COP}}$$

$$\text{COP} = \frac{3.516}{\text{kW/ton}}$$

FOULING FACTOR

ENGLISH I-P (ft ² °F hr/Btu)	EQUIVALENT SI METRIC (m ² k/kW)
0.0001	.018
0.00025	.044
0.0005	.088
0.00075	.132

For Steam systems (I-P system):

$$\text{COP} = \frac{\text{Refrigeration effect (Btu/hr)}}{\text{Steam flow (lb/hr) x (Steam supply (Btu/lb) - condensate return (Btu/lb))}}$$

For Steam systems (SI system):

$$\text{COP} = \frac{\text{Refrigeration effect (kW)}}{\text{Steam flow (kg/s) x (Steam supply (kJ/kg) - condensate return (kJ/kg))}}$$

